Technical Report CADD-93-1
June 1999
(Updated)

Tri-Service CADD/GIS Technology Center

CADD Details Library

Report 2
Mechanical Details

Published by U.S. Army Engineer Research and Development Center,
Waterways Experiment Station

Library of CADD Details

Report 1	Architectural Details
Report 2	Mechanical Details
Report 3	Electrical Details
Report 4	HTRW Details
Report 5	Structural Details
Report 6	Civil/Site Details

Technical Report CADD-93-1
June 1999
(Updated)

CADD Details Library

Report 2
Mechanical Details

by Tri-Service CADD/GIS Technology Center

U.S. Army Engineer Research and Development Center
Waterways Experiment Station
3909 Halls Ferry Road
Vicksburg, MS 39180-6199

Report 2 of a Series

Waterways Experiment Station Cataloging-in-Publication Data

CADD details library / by Tri-Service CADD/GIS Technical Center.
6 v. : ill. ; 28 cm. — (Technical report ; CADD-93-1 repts.1-6 1999)
Includes bibliographical references.
rept. 1. Architectural details (updated)—rept. 2. Mechanical details (updated)—rept. 3. Electrical details (updated)—rept. 4. HTRW details (updated)—rept. 5. Structural details—rept. 6. Civil/Site details—rept.
1. Computer-aided design. 2. Computer-aided engineering. 3. Architectural drawing —Detailing — Computer programs. I. United States. Army. Corps of Engineers. II. U.S. Army Engineer Research and Development Center. III. Tri-Service CADD/GIS Technology Center (U.S.) IV. Title: Architectural details. V. Series: Technical report (U.S. Army Engineer Research and Development Center) ; CADD-93-1 repts.1-6 1999.
TA7 W34 no.CADD-93-1 repts.1-6 1999

Contents

Summary

Several years ago, before computer-aided design and drafting (CADD) became the standard drafting tool in design, a seasoned draftsman might require, on the average, 40 hours to develop a sheet of construction details by hand. Through the use of CADD, the effort of creating a single detail has been reduced considerably. Once the designer has created a detail using CADD tools, he/she can save the detail to a file and use the detail over and over in different construction projects. Eventually, the designer will have compiled a library of details that he/she will consistently use. These details can be easily inserted into a detail sheet and then modified to meet the project requirements and specifications. This development and reuse of CADD details represents a considerable time-savings tool to the designer.

When the Tri-Service CADD/GIS Technology Center (the Center) was established in 1992, one of the first tasks was the compilation of a CADD Details Library utilizing details created by tri-service personnel. The Center did not expend design funds to hire an architect/engineer or use in-house resources to develop completely new details; instead these tri-service details were organized into a generic format and cataloged by type.

To further simplify the use of the details library, the former Architectural Automation Field Working Group (AAFWG) tasked the Center to develop an icon-driven software retrieval system. Developed using MDL and AutoLISP programming, the retrieval software ran on both MicroStation and AutoCAD platforms using UNIX, DOS, Windows, Windows NT, and Windows 95 operating systems.

Typically, detailing on a design project does not begin prior to the 35-percent design phase. At the 35-percent phase, the designer has defined the building's structure and envelope requirements and is ready to begin selecting typical project details.

After reviewing details in hardcopy or electronic format and identifying usable details, the designer/draftsman initiates the "CADD Detail Manager" program. The designer scrolls through the details listing, identifies the desired detail, reviews it within the display box, selects the required scale, and then places it on the detail sheet. This process is repeated until the entire sheet is filled. Simple modifications to the details in order to meet specific job requirements/ specifications complete the sheet. The designer may call up the CADD Detail Manager while in any design file, thus enabling detail placement anywhere within a set of drawings.

The CADD Details Library should always be considered a "living" library. Since the conception of the idea for this project, this philosophy has proven to be true. In 1995 the Center released the first CADD Details Library CD-ROM to enthusiastic response. The first CD-ROM contained over 1,200 details representing the Architectural; Mechanical; Electrical; and Hazardous, Toxic,

and Radioactive Waste disciplines. User demand resulted in the addition of Civil/Site, Structural, Interior Design, and Landscape Architectural details to the current edition of the CADD Details CD-ROM. With the push toward using the metric system in the tri-services, 100 of the architectural details contained in the first CD-ROM were converted to metric format. Because of the desire for a "paperless" environment, all documents related to the current version of the CADD Details Library have been released totally in electronic format on the CD-ROM. This gives the designer the option of printing out only the documents (or only the pages) that he/she requires, thereby saving printing costs for the Center. Through efforts such as these, the CADD Details Library will continue to grow to include all the design disciplines with costs incurred for technical review/modification, CD-ROM reproduction, and distribution.

It is the Center's hope that the efforts of the Center, with the backing of the former Field Working Groups and the currently existing Design/Construction Field Working Group, to develop comprehensive, multidiscipline sets of generic details will not only help designers in their daily work but also demonstrate the tri-service commitment to CADD productivity.

Preface

This report is the second volume of a series of reports consisting of architectural; mechanical; electrical; hazardous, toxic, and radioactive waste (HTRW); structural; and civil/site details. These reports are part of the Tri-Service CADD/GIS Technology Center's (the Center) initiative to develop a standard methodology for the development, documentation, and use of generic design details in computer-aided design and drafting (CADD) systems. By providing both a startup set of details and a menu-driven software retrieval program, the Center hopes to ensure easy accessibility to generic design details and encourage their use in the CADD environment.

It must be emphasized that the intent of this document is not to provide "Standard Details," but to furnish CADD users with a starting point for the development of project-specific details. Although reasonable efforts have been made to verify that the enclosed details are technically correct and meet existing, generally available building code requirements, there is no expressed or implied warranty of correctness or compliance. It is the final responsibility of the user/designer to ensure the accuracy, completeness, applicability, workability, and code compliance of all details whether used or misused in whole or in part.

Project Manager for the CADD Details Library was Stephen C. Spangler of the Center. Original authors of the CADD Details Library reports were James T. Wilson and Stephen C. Spangler of the Center. Chief of the Center was Harold L. Smith. The Center is located in the Information Technology Laboratory (ITL), U.S. Army Engineer Waterways Experiment Station (WES), Vicksburg, MS, a complex of five laboratories of the U.S. Army Engineer Research and Development Center (ERDC). During preparation and publication of this report, Director of ITL was Dr. N. Radhakrishnan, and Commander of ERDC was COL Robin R. Cababa, EN. This report was prepared and lublished at the WES complex of ERDC.

The Center would like to thank Mr. Stan Shirk, Omaha District, for his continued devotion and efforts to the CADD Details Library project. The Center would also like to recognize Mr. Todd Blakley, formerly of the Sacramento District, for his contributions as former chairman of the Design/Construction Field Working Group's (FWG) Details Subcommittee. A special acknowledgment goes to Mr. Stephen Goodin, South Atlantic Division, and Mr. Alain Bernier, Southwestern Division, for their support in the initial development of the details library concept.

The Tri-Service CADD/GIS Technology Center would like to acknowledge the contributions of the following sites who helped in submitting and/or formatting details for this release of the CADD Details Library.

Brooks Air Force Base

Department of Veterans Affairs

Naval Air Station, Fort Worth

NAVFACENGCOM, Western Division

Navy Public Works Center, Washington, D.C.

Tinker Air Force Base

U.S. Army Corps of Engineers, Charleston District

U.S. Army Corps of Engineers, Fort Worth District

U.S. Army Corps of Engineers, Little Rock District

U.S. Army Corps of Engineers, Mobile District

U.S. Army Corps of Engineers, Omaha District

U.S. Army Corps of Engineers, Pacific Ocean Division

U.S. Army Corps of Engineers, Pittsburgh District

U.S. Army Corps of Engineers, Sacramento District

U.S. Army Corps of Engineers, Seattle District

U.S. Army Corps of Engineers, Transatlantic Programs Center

U.S. Army Engineering and Support Center, Huntsville

Design/Construction FWG Details Subcommittee

Stan Shirk (Chairman), U.S. Army Corps of Engineers, Omaha District

Elbert Godwin, U.S. Army Corps of Engineers, Fort Worth District

Mark Hall, Department of Veterans Affairs

Lee Meier, Scott Air Force Base, IL

Jerry Sakahara, U.S. Army Corps of Engineers, Sacramento District

Stephen Spangler, Tri-Service CADD/GIS Technology Center

Beneficial comments (recommendations, enhancements, deletions, etc.) which may be of use in improving this document should be addressed to:

U.S. Army Engineer Research and Development Center, Waterways Experiment Station
Tri-Service CADD/GIS Technology Center
ATTN: CEWES-ID-C/Spangler
3909 Halls Ferry Road
Vicksburg, MS 39180-6199

1 Introduction

The use of computer-aided design and drafting (CADD) systems within the Department of Defense (DoD) has produced an increase in design efficiency while netting an appreciable reduction in overall design cost. In some offices, a 30- to 40-percent reduction in design/drafting man-hours, over the traditional "on-the-board" design effort, has been realized. These improvements have been achieved through the utilization of discipline-specific CADD design packages, the sharing of CADD-developed project information, and the reuse of design information. Recognizing the increased productivity represented in the reuse and adaptation of design and construction details, the Tri-Service CADD/GIS Technology Center (the Center) initiated a project to collect and disseminate generic design details within the DoD.

Based on work completed by the former Mechanical Field Working Group in November 1991, and ongoing work by the former Electrical and Architectural Automation Field Working Groups, the Center recognized the necessity to pool the resources of all DoD design disciplines to ensure consistency in detail development. Issues concerning scale, levels/layers, line thickness, text, colors, layout, naming convention, and file storage/retrieval procedures needed to be resolved to the satisfaction of all the design disciplines before the Center could continue. The Center tasked the former Architectural Automation Field Working Group to prepare applicable criteria and procedures for standardizing the development of the CADD Details Library.

In accordance with the Metric Conversion Act of 1975 (Public Law 94-168) as amended by the Omnibus Trade and Competitiveness Act of 1988 (Public Law 100-418), and Executive Order (EO) 12770 dated July 25, 1991, this and future editions of the CADD Details Library will include Standard International (metric) details. Appendix B contains information on changes that will occur in design drawings and construction as a result of the conversion to the metric system.

2 CADD Details Library

Library Creation

"Evolution" is the best description of the process for incorporating the suggested format for creating generic details. Agencies currently developing detail libraries are encouraged to begin incorporating the format into their daily design efforts, and not attempt a complete revamping of their existing detail libraries. As details are created, they should be included in the agency's detail library and submitted to the Center for possible inclusion in the DoD-wide master library. By no means should the CADD Details Library ever be considered a completed product. It is only the **beginning** of what should be a daily routine of adding and revising details for all design disciplines within the tri-services.

Detail Integrity

Although a liability disclaimer covering all the details is included as part of the CADD Details Library, each detail submitted for inclusion into the library should be reviewed by the submitting agency for integrity and compliance with current design criteria. It will be extremely helpful to the Center and the Design/Construction Field Working Group's Details Subcommittee if each detail is properly reviewed prior to submitting it for placement into the Library.

Creating a Detail

Graphics

When developing a detail, draw the detail at full size (1 inch = 1 inch (inch-pound) or 1 mm = 1 mm (metric)) (Figure 1). Each detail should exist in an individual drawing file, either in AutoCAD's .dwg or MicroStation's .dgn formats. MicroStation details should not be created as cells or as part of a cell library. AutoCAD details should not be saved as blocks or blocks written out to a file (wblocks).

For detail uniformity, a standard detail layout has been developed (Figures 2 and 3). This box is only a guide for laying out details; it is understood that not all details can fit into the layout. When producing details larger than the standard detail layout box, every effort should be made to follow the format as much as possible. For example, keep the detail origin and title in the lower left corner of the detail and try to use multiples of the standard detail layout box (2 high, 2 wide, etc.).

Working units

For MicroStation details, the working units should be set to 1:12:8000 (ft:in:PU) for inch-pound details and 1:1:10 (mm:none:PU) for metric details. For AutoCAD details, the default "UNITS" setting should be "#4 Architectural" for inch-pound details and "#2 Decimal" for metric details.

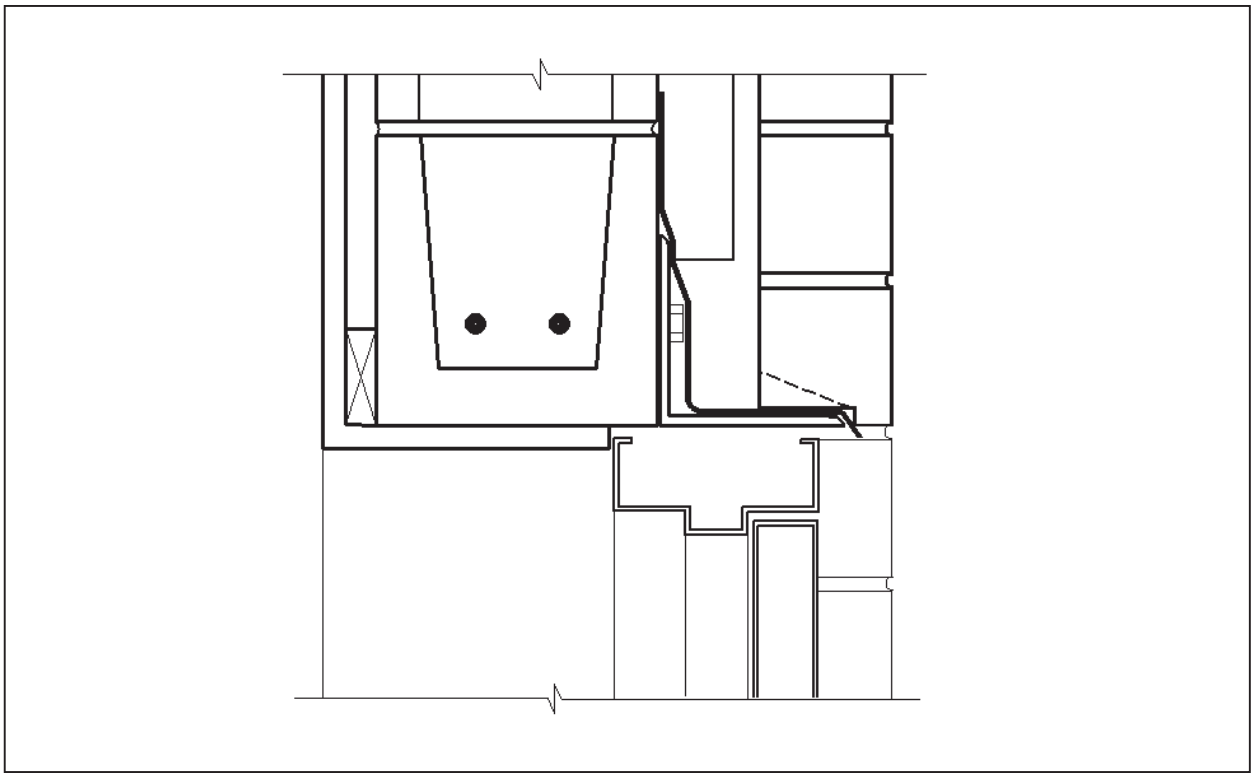

Figure 1. Detail drawn at full size

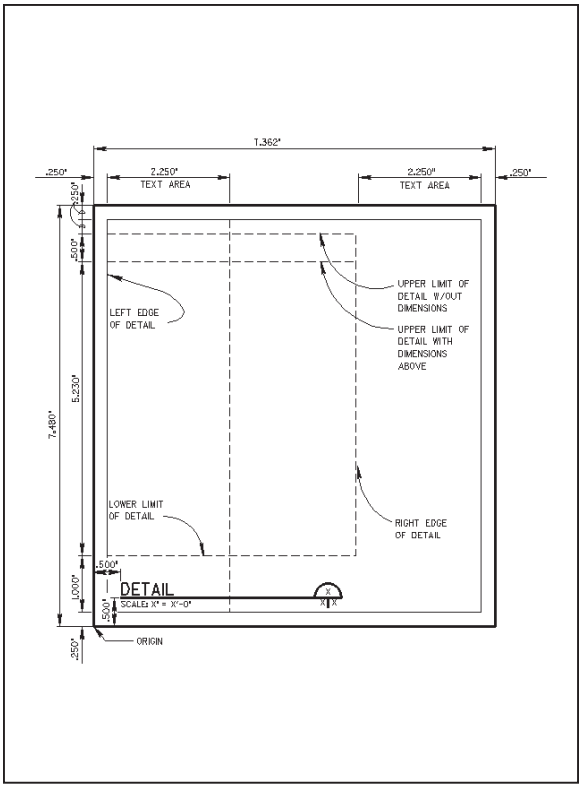

Figure 2. Inch-pound detail layout box

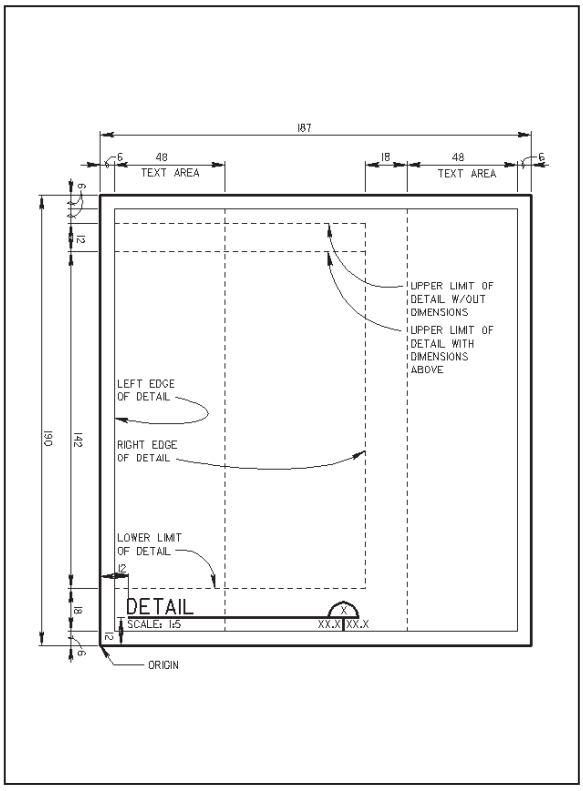

Figure 3. Metric detail layout box

Levels/layers

The previous edition of the CADD Details Library proposed a level/layer scheme based on the pen weight at which graphics would be plotted. Feedback from the field indicated that this was too restrictive and unclear. Users want to be able to "turn off" individual components of a detail versus all items drawn at a certain line weight. For instance, a designer may want to be able to turn off the CMU in a detail but not the reinforcing rebar.

As a result of this input, levels/layers for details have been developed for Release 1.8 of the Tri-Service A/E/C CADD Standard (Table 1). Levels/layers are grouped into the most common construction materials/items required to create a particular discipline's details.

Color/line widths

The primary purpose of color is to provide a drawing with visual depth and clarity or, in some CADD systems, to assign plotted line widths. The previous edition of the CADD Details Library established a specific color and line weight to each level/layer. Users found this guideline to be too restrictive. Often a user will want to show items on the same level/layer at different line weights to emphasize particular parts of a detail over others. As a result, the user may use any of the colors shown in Table 2 to create details. However, the line weights shown in the table beside each color *have* to be associated with that color in order to ensure that details are plotted at the correct visual weight.

Patterning/hatching

Patterning/hatching should be added to the detail on level/layer M-ANNO-PATT (Figure 4). When the detail is being patterned or hatched, only the default pattern or hatch libraries supplied with MicroStation or AutoCAD should be used.

Text

After the scale of the detail is determined, text should be placed at heights corresponding to Tables 3 and 4. This ensures that all notes and dimensions will be plotted at a height of 1/8 inch (3 mm) and the detail title will be plotted at a height of 1/4 inch (6 mm). For example, in Figure 5, the notes should be placed at a height of 1/2 inch and the detail title should be placed at a height of 1 inch for a detail that is plotted at a scale of 3" = 1' - 0". The text style used for details should be Font 1 for MicroStation users and "ROMANS" for AutoCAD users.

Abbreviations

Abbreviations for words or phrases frequently used in details should be as noted in Appendix A. When possible, abbreviations should be kept to a minimum. Other abbreviations, particularly discipline-unique abbreviations, may be used but must not conflict with those in Appendix A.

Detail Naming

File names for the master set of details are based on *UniFormat* (Interim Edition) produced by the Construction Specifications Institute (CSI); *UniFormat* is used with permission from CSI. *UniFormat* may be purchased from CSI by calling (800)689-2900. Level 1 and Level 2 *UniFormat* categories are used for the first three alphanumeric characters of the file name. The Code, Sub-Code, Detail Number, and graphic type characters are non-*UniFormat* conventions developed specifically by the Center for the CADD Details Library file naming methodology (see Figure 6).

Table 1
Mechanical Detail Levels/Layers

Level #	Level/Layer Name	Level/Layer Description
1	M-ANNO-DIMS	Witness/extension lines, dimension arrowheads/dots/slashes, dimension text
3	M-ANNO-NPLT	Construction lines, area calculations, review comments
4	M-ANNO-PATT	Patterning/hatching
6	M-ANNO-SYMB	Reference bubbles, matchlines and breaklines
7	M-ANNO-TEXT	Detail title text, leaderlines/arrowheads and associated text, notes
9	M-DETL-GENF	General features
10	M-DETL-ACCS	Accessories
13	M-DETL-BOIL	Boilers
15	M-DETL-CABS	Cabinets and enclosures
18	M-DETL-COIL	Coils and fin tubes
21	M-DETL-DUCT	Ducts
22	M-DETL-EQPT	Equipment and fixtures
26	M-DETL-FANS	Fans
35	M-DETL-GRLS	Grilles and louvers
37	M-DETL-INSL	Insulation (no patterning)
42	M-DETL-MOTR	Motors
44	M-DETL-PIPE	Piping
45	M-DETL-PUMP	Pumps and compressors
49	M-DETL-STRC	Structural support features
50	M-DETL-TANK	Tank
51	M-DETL-TRAP	Traps and drains
55	M-DETL-VENT	Vents
56	M-DETL-VLVE	Valves and fittings
57	M-DETL-WIRE	Electrical features

Table 2
Color/Line Width Guidelines

Color	AutoCAD Color #	MicroStation Color #	Line/Pen Width
Blue	5	1	0.007 in. (0.18 mm), LW = 0
Grey	8	9	0.007 in. (0.18 mm), LW = 0
Red	1	3	0.010 in. (0.25 mm), LW = 1
Green	3	2	0.010 in. (0.25 mm), LW = 1
Yellow	2	4	0.014 in. (0.35 mm), LW = 2
Magenta	6	5	0.014 in. (0.35 mm), LW = 2
Cyan	4	7	0.020 in. (0.50 mm), LW = 3
White	7	0	0.028 in. (0.70 mm), LW = 5

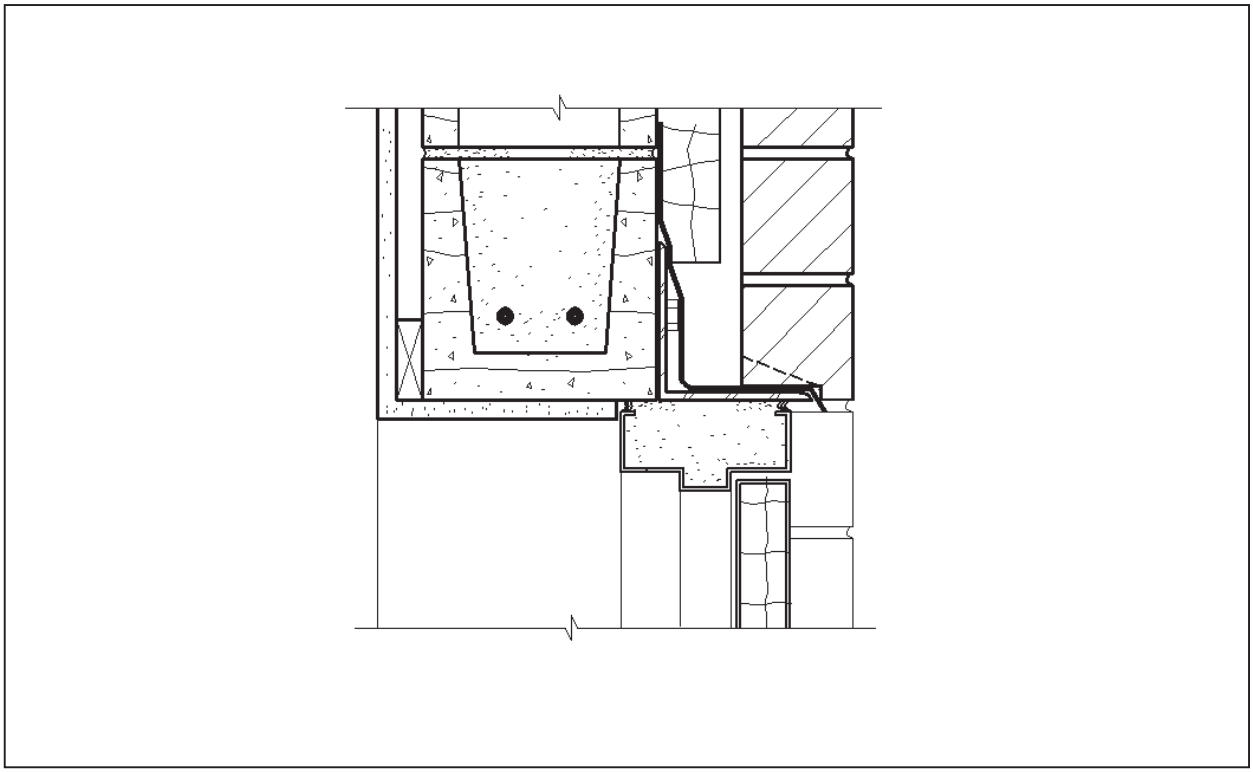

Figure 4. Patterning/hatching added to detail

Table 3
Inch-Pound Text Heights

Detail Scale	Height at which Notes and Dimensions Should be Placed	Height at which Detail Title Text Should be Placed
1/32 in. = 1 ft - 0 in.	4 ft	8 ft
1/16 in. = 1 ft - 0 in.	2 ft	4 ft
1/8 in. = 1 ft - 0 in.	1 ft	2 ft
1/4 in. = 1 ft - 0 in.	6 in.	1 ft
3/8 in. = 1 ft - 0 in.	4 in.	8 in.
1/2 in. = 1 ft - 0 in.	3 in.	6 in.
3/4 in. = 1 ft - 0 in.	2 in.	4 in.
1 in. = 1 ft - 0 in.	1-1/2 in.	3 in.
1-1/2 in. = 1 ft - 0 in.	1 in.	2 in.
3 in. = 1 ft - 0 in.	1/2 in.	1 in.
6 in. = 1 ft - 0 in.	1/4 in.	1/2 in.
Full Size	1/8 in.	1/4 in.

Table 4
Metric Text Heights

Detail Scale	Height at which Notes and Dimensions Should be Placed	Height at which Detail Title Text Should be Placed
1 : 200	600 mm	1200 mm
1 : 125	375 mm	750 mm
1 : 100	300 mm	600 mm
1 : 75	225 mm	450 mm
1 : 50	150 mm	300 mm
1 : 25	75 mm	150 mm
1 : 20	60 mm	120 mm
1 : 10	30 mm	60 mm
1 : 5	15 mm	30 mm
1 : 2.5	7.5 mm	15 mm
Full Size	3 mm	6 mm

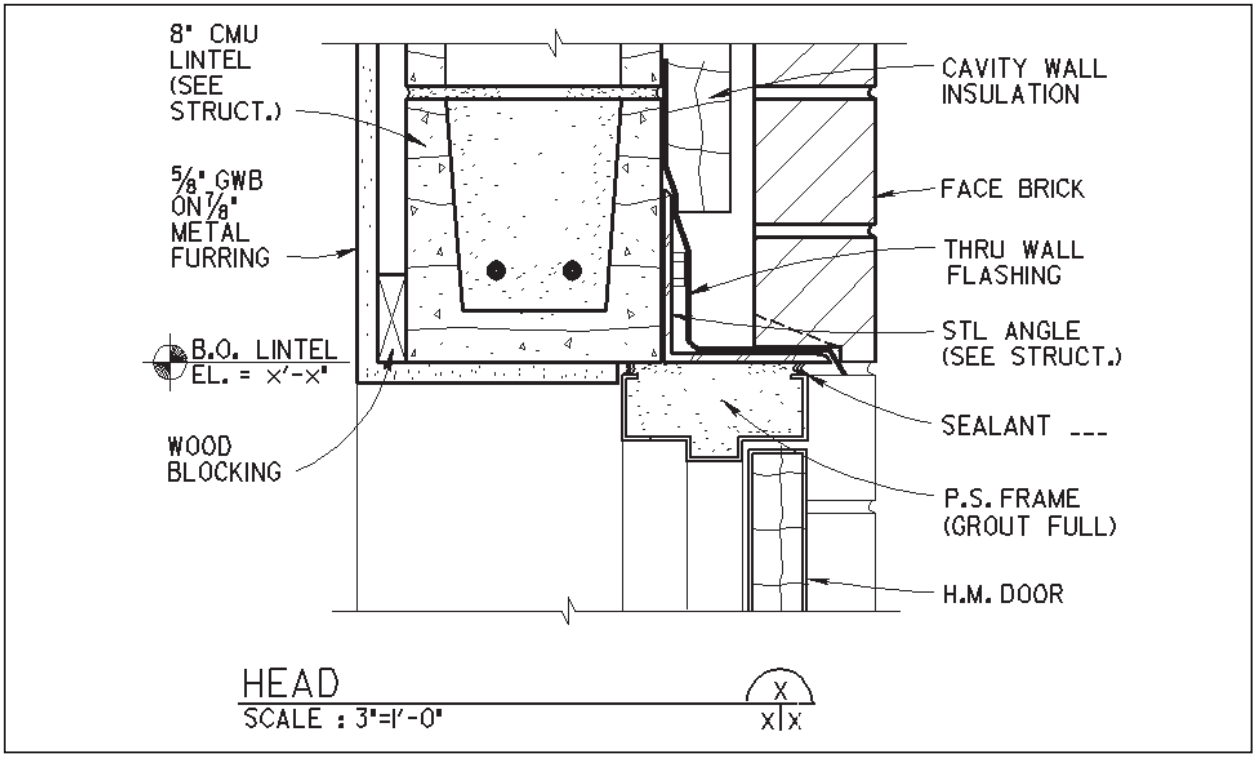

Figure 5. Text, dimensions, leader lines, and titles added to detail

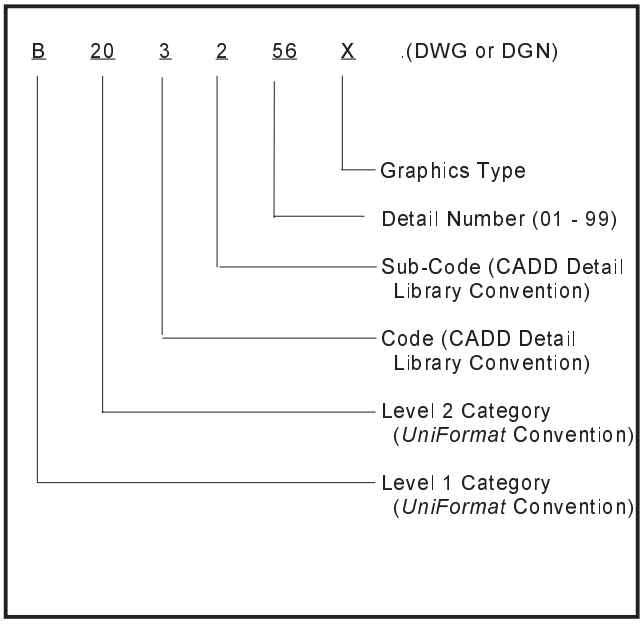

Figure 6. Naming convention. Note: A full listing of *UniFormat* categories and codes is outlined in Chapter 5, "Index of Details"

An example of a detail name is provided below.

EXAMPLE: A102352P.dwg

Level 1 Category:
A = Substructure

Level 2 Category:
10 = Foundations

Code:
2 = Special Foundations

Sub-Code:
3 = Shoring and Underpinning

Detail Number:
52 = Detail #52

Graphics Type:

E = Elevation	P = Plan
I = Isometric	S = Schematic
N = Notes	X = Section

3 CADD Detail Manager

Introduction

The CADD Details Library is supplied on a CD-ROM with a menu-driven retrieval system called the CADD Detail Manager (CDM). The CDM allows the user to select border sheets, preview details, and scale details for proper placement into a drawing file.

Details are located within the CDM by selecting a Discipline (e.g., Architectural, Mechanical, etc.), a combination of Level 1 and Level 2 Categories (e.g., Exterior Closure, Roofing, etc.), and the Detail Code (e.g., Exterior Walls, Exterior Windows, etc.). Once all three selections are made, a list of details within the selected code for that discipline will be displayed. Individual details may be previewed by selecting (highlighting) the detail names displayed within the list box. Choosing the appropriate scale and inserting the detail into the current drawing completes the selection/placement process.

Startup

Although the AutoCAD and MicroStation versions of the CDM function similarly, there are minor differences in the way these utilities work. These differences will be discussed in the following sections.

MicroStation Version (95/SE)

The MicroStation version of the CADD Detail Manager was developed using MicroStation Development Language (MDL). To start the CADD Detail Manager, create a new or open an existing design file. In the MicroStation Key-in window, enter the following command:

mdl load detail

When this command is entered, the CADD Detail Manager disclaimer box will open. After the "OK" button is clicked, the CADD Detail Manager Setup box will appear (Figure 7). From this point on, the use of the CADD Detail Manager in either AutoCAD or MicroStation is the same (see "CADD Detail Manager Setup").

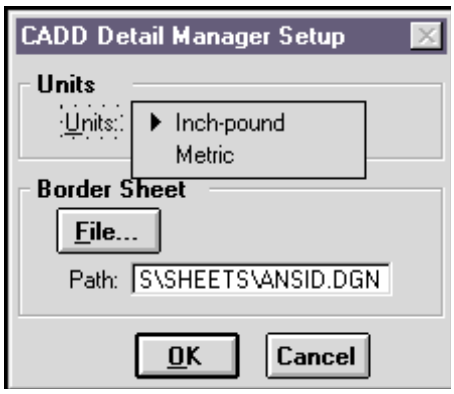

Figure 7. Detail Manager Setup box

AutoCAD Version (Release 13/14)

The AutoCAD version of the CADD Detail Manager was developed using AutoLISP. To start the CADD Detail Manager within AutoCAD, first open a new drawing. At the Command line, the following needs to be typed:

Command: CDM

When this command is entered, the CADD Detail Manager disclaimer box will open. After clicking on the "OK" button, the user will have the choice of either starting a new detail sheet or opening an existing detail sheet (Figure 8).

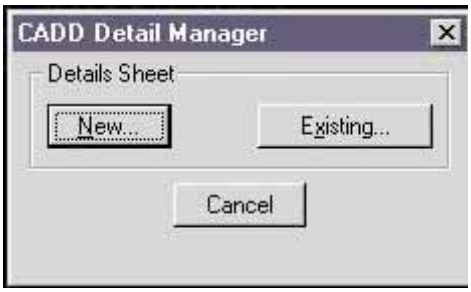

Figure 8. New or existing sheet option box

Choosing the New option from Figure 8 starts the CADD Detail Manager Setup (Figure 7). From this point, the use of the CADD Detail Manager in either AutoCAD or MicroStation is the same.

Choosing the Existing option will allow the user to search for an existing details sheet using a file manager routine (Figure 9).

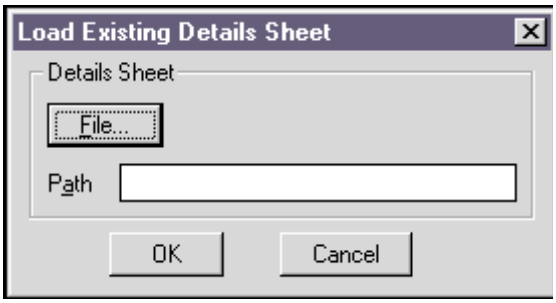

Figure 9. Existing details sheet file search

CADD Detail Manager Setup

As shown in Figure 7, the user first has to set the units of the drawing—either inch-pound or metric. The user then has the option of selecting an existing border sheet file, one of the metric border sheets included on the CADD Details Manager CD, or no border sheet at all. If an existing border sheet is chosen, that sheet has to have been drawn full size (e.g., an ANSI D size border sheet has to measure 22 in. by 34 in.). Once all desired settings have been chosen, click the "OK" button, which will start the CADD Detail Manager.

Note: In MicroStation, if inch-pound units are chosen, the working units are reset to 1:12:8000 and for metric units, the working units are reset to 1:1:10 (Figure 10). These working units conform to those mandated in Release 1.8 of the Tri-Service A/E/C CADD Standard.

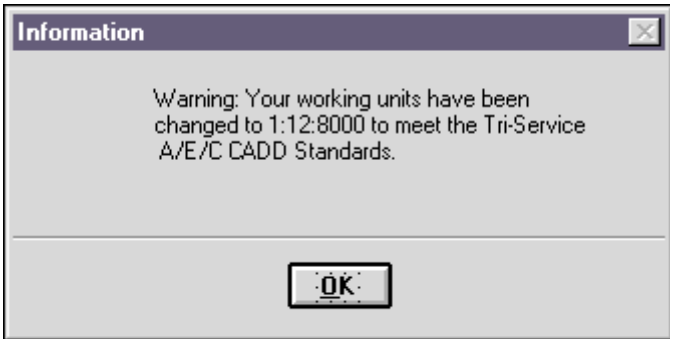

Figure 10. Working units warning box

CADD Detail Manager Use

Within the CADD Detail Manager (Figure 11), details are cataloged first by discipline (i.e., Architectural, Electrical, Mechanical, etc.). Once a discipline is chosen, the user then can select from different UniFormat Level 2 Categories and Detail Codes until a list of details within those selections appears. Each line within the resulting list of details gives three pieces of information: the name of the detail, the detail description, and the insertion scale for that detail. Clicking on a particular detail causes an image of that detail to appear in the Preview box.

Before a desired detail can be inserted, the correct insertion scale for that detail needs to be set (as mentioned previously, the insertion scale is listed along with the detail name and description in the Available Details list box). To set the insertion scale, click the "Scale" button. The user will then be taken to a scale conversion dialog box (Figure 12). From this box, the scale matching that noted in the detail description should be chosen (Note: the user must select a scale, otherwise the detail will not insert at the proper size). Once the correct scale is chosen, the user will be taken back to the CADD Detail Manager screen (Figure 11), where the "Insert" option should be chosen. The user will then be allowed to drag the detail to the desired position and insert it into the drawing. This detail should then be edited/modified to meet site-specific requirements. Similarly, more details can be inserted into the existing drawing until a complete sheet of details is created.

Other Installation Options

As delivered, the setup routines included with the CADD Details Library CD install configuration files that point to the CD-ROM drive as the location for certain files. It is possible that a site may want these files shared over a server. In order to locate the details files, the installed configuration files need to be edited to point to the new location. In AutoCAD, this file is called cdm_set.dfs and is saved to the AutoCAD "Support" directory. In MicroStation, this

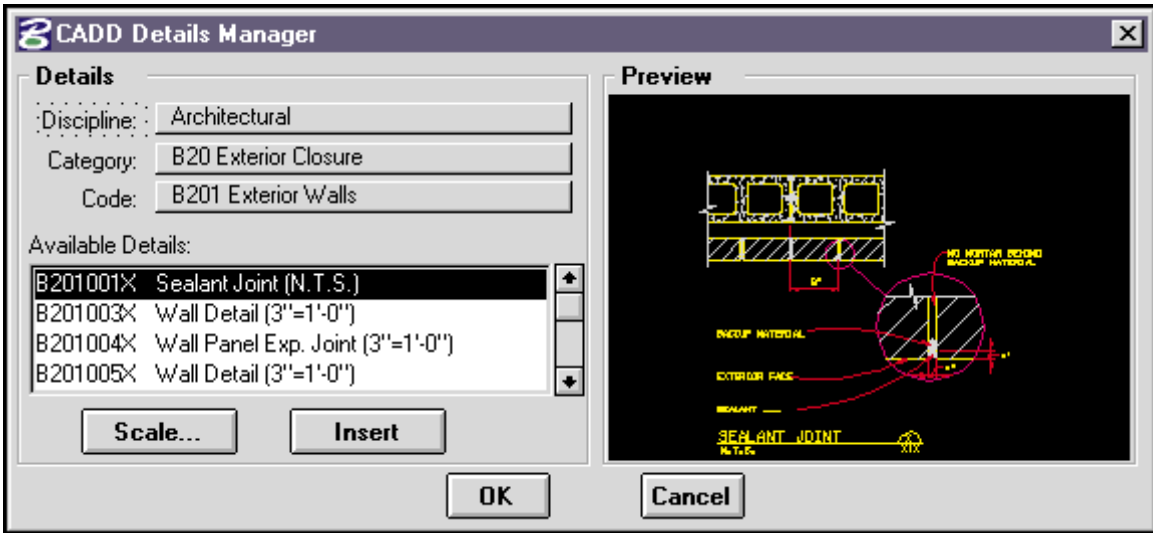

Figure 11. CADD Detail Manager

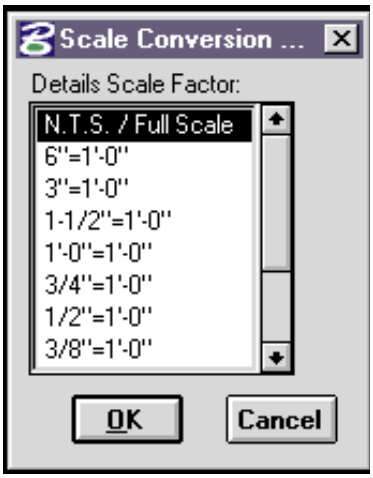

Figure 12. Scale conversion

file is called ustncfg.dos and is stored in a new directory called “Details” under the MicroStation directory. Both configuration files contains directory paths similar to the following (in this case, the CD-ROM drive was E:):

E:\DETAILS\SHEETS\ANSID.DGN

C:\win32app\USTN95\DETAILS\SETUP.UNI

E:\DETAILS\INDEX\

E:\DETAILS\USTN\

If the files contained within the directory “Details” on the CD are copied to a server or another location, then the path to those files needs to be changed appropriately.

4 Design/Construction Field Working Group

The Design/Construction Field Working Group (FWG) is composed of architects, interior designers, and engineers from various design agencies within the Army, Navy, Air Force, and Corps of Engineers. The Design/Construction FWG's primary function is to serve as a leader in the improved usage of CADD technology as it relates to the design disciplines. The group reviews and reports on the status of CADD within the tri-services, recommends and/or prepares standards, and implements productivity enhancements within DoD.

Table 5 lists current Design/Construction FWG members.

Table 5
Design/Construction Field Working Group

Member	Site	Service
Brenda Langheld	Brooks AFB	Air Force
James Roesch	Grand Forks AFB	Air Force
Larry Strother	Tyndall AFB	Air Force
Sharrol Toenjes	Scott AFB	Air Force
David Gutierrez	Fort Sam Houston	Army
Mike Luhrman	Fort Sam Houston	Army
Alex Shum	Fort Sam Houston	Army
Robert Weaver	Fort Carson	Army
Richard Allwes	Pittsburgh District	Corps
Lisa Edwards	Huntington District	Corps
Ghassem Khosrownia	Sacramento District	Corps
Stan Shirk	Omaha District	Corps
Marsha Walkup	Kansas City District	Corps
Gary Boyd	Southern Division	Navy
James Gale	Atlantic Division	Navy
Edward Ruckle	Southwest Division	Navy

5 Index of Details

Note: "*" = .dgn/.dwg

A SUBSTRUCTURE

A10 FOUNDATIONS
A101 Standard Foundations
A1010 Misc. Standard Foundation Details
A1011 Wall Foundations
A1012 Column Foundations

A102 Special Foundations
A1020 Misc. Special Foundation Details
A1021 Driven Piles
A1022 Bored/Augured Piles
A1023 Shoring and Underpinning
A1024 Dewatering
A1025 Raft Foundations
A1026 Cofferdams

A103 Slabs on Grade
A1030 Misc. Slab on Grade Details
A1031 Standard Slabs on Grade
A1032 Structural Slabs on Grade
A1033 Inclined Slabs on Grade
A1034 Trenches
A1035 Pits and Bases
A1036 Subdrainage Systems
A1037 Perimeter Insulation

A20 BASEMENT CONSTRUCTION
A201 Basement Excavation
A2010 Misc. Basement Excavation Details
A2011 Excavation for Basement
A2012 Backfill and Compaction
A2013 Excavation Support Systems

A202 Basement Walls
A2020 Misc. Basement Wall Details
A2021 Basement Wall Construction
A2022 Basement Wall Vertical Waterproofing
A2023 Basement Wall Dampproofing
A2024 Basement Wall Vapor Retarders and Insulation
A2025 Basement Wall Interior Skin

B SHELL

B10 SUPERSTRUCTURE
B101 Floor Construction
B1010 Misc. Floor Construction Details
B1011 Floor Structural Frame
B1012 Structural Interior Walls Supporting Floors
B1013 Floor Decks, Slabs and Sheathing
B1014 Balcony Floor Construction
B1015 Mezzanine Construction
B1016 Ramps
B1017 Floor Construction Vapor Retarders, Air Barriers, and Insulation
B1018 Floor Construction Fireproofing
B1019 Floor Construction Firestopping

B102 Roof Construction
B1020 Misc. Roof Construction Details
B1021 Roof Structural Frame
B1022 Structural Interior Walls Supporting Roofs
B1023 Roof Decks, Slabs, and Sheathing
B1024 Canopies

C1031 Visual Display Boards, Telephones, Identifying Devices, and Postal Specialties
C1032 Compartments and Cubicles
C1033 Interior Louvers and Vents
C1034 Service Wall Systems and Wall and Corner Guards
C1035 Fireplaces and Stoves
C1036 Pedestrian Control Devices
C1037 Lockers, Wardrobes, Closet, Storage, and Shelving Specialties
C1038 Toilet and Bath Accessories (Scales)

C20 STAIRWAYS
C201 Stair Construction
C2010 Misc. Stair Construction Details
C2011 Cast-in-Place Stair Construction
C2012 Precast Concrete Stair Construction
C2013 Metal Stair Construction
C2014 Wood Stair Construction
C2015 Fire Escapes

C202 Stair Finishes
C2020 Misc. Stair Finish Details
C2021 Tile Stair Finishes
C2022 Terrazzo Stair Finishes
C2023 Stone Stair Finishes
C2024 Unit Masonry Stair Finishes
C2025 Resilient Stair Finishes
C2026 Carpet Stair Finishes
C2027 Special Flooring Stair Finishes
C2028 Stair Treatment/Painting
C2029 Stair Railings/Soffits

C30 INTERIOR FINISHES
C301 Interior Wall Finishes
C3010 Misc. Wall Finish Details
C3011 Concrete Wall Finishes
C3012 Wood Wall Paneling
C3013 Lath and Plaster Wall Finishes
C3014 Gypsum Board Wall Finishes
C3015 Tile and Terrazzo Wall Finishes
C3016 Stone Facing and Acoustical Wall Finishes
C3017 Special Wall Finishes
C3018 Wall Carpet
C3019 Interior Wall Painting, Wall Coverings, and Special Interior Wall Coatings

C302 Interior Floor Finishes
C3020 Misc. Floor Finish Details
C3021 Concrete Floor Finishes
C3022 Tile Floor Finishes
C3023 Terrazzo Floor Finishes
C3024 Wood Flooring
C3025 Stone Flooring
C3026 Unit Masonry Flooring
C3027 Resilient Flooring
C3028 Carpet Flooring
C3029 Access and Special Flooring, Floor Treatment, and Floor Painting

C303 Interior Ceiling Finishes
C3030 Misc. Interior Ceiling Finish Details
C3031 Concrete Ceiling Finishes
C3032 Wood Ceiling Paneling
C3033 Lath and Plaster Ceiling Finishes
C3034 Gypsum Board Ceiling Finishes
C3035 Acoustical Ceiling Treatment
C3036 Special Ceiling Surfaces
C3037 Special Ceiling Coatings
C3038 Interior Ceiling Painting

D SERVICES

D10 CONVEYING SYSTEMS
D101 Vertical Transportation Systems
D1010 Misc. Details
D1011 Dumbwaiters
D1012 Elevators
D1013 Escalators
D1014 Lifts

D102 Other Transportation Systems
D1020 Misc. Details
D1021 Moving Walks
D1022 Aircraft Passenger Loading Systems

D103 Other Conveying Systems
D1030 Misc. Conveying Details

D1031 Material Handling Systems
D1032 Bridgecranes
D103201E.* - Crane Clearance Diagram
D103202E.* - Crane End Truck Arrangement
D103203P.* - (Omitted)
D103204E.* - Crane Transfer/Interlock Mechanism
D1033 Monorails
D1034 Jib Cranes
D103401E.* - Jib Crane Detail
D103402X.* - (Omitted)
D1035 Misc. Hoists
D1036 Turntables
D1037 Scaffolding
D1038 Special Crane Supports

D20 PLUMBING SYSTEMS

D201 Plumbing Fixtures

D2010 Misc. Plumbing Fixture Details
D201002E.* - Flush Valve Support Detail
D201003S.* - (Omitted)
D201004S.* - (Omitted)
D201005E.* - (Omitted)
D201006E.* - Clothes Washer Connection Detail
D201007E.* - (Omitted)
D201008E.* - Drain Valve Detail
D201009I.* - Backup Plate for Lavatories and Urinals for Masonry Walls
D201010E.* - Typical Mounting for Cast Iron Lavatories on Masonry Walls
D201011S.* - (Omitted)
D201012E.* - Hot/Cold Water Mixing Gooseneck Faucet Detail
D201013E.* - Lavatory Mounting for Metal Studs
D201014S.* - (Omitted)
D201015E.* - Freeze-Proof Wall Hydrant
D201016E.* - Freeze-Proof Yard Hydrant (Box Type)
D201017E.* - Yard Hydrant (Post Type)
D2011 Water Closets
D2012 Urinals
D2013 Lavatories
D201301E.* - Lavatory Tailpiece Detail
D2014 Sinks
D201401X.* - Mop Sink Detail
D2015 Showers
D201501E.* - Emergency Shower with Eye Wash
D201502E.* - Emergency Shower with Eye Wash Detail
D201503E.* - Safety Shower - Eye Wash Detail
D201504 .* - (Omitted)
D201505E.* - (Omitted)
D201506E.* - Frost-Proof Drench Shower and Eye Wash Unit
D2016 Bathtubs
D2017 Basins
D2018 Drinking Fountains/Coolers
D201801S.* - (Omitted)
D201802E.* - Free Standing Drinking Water Cooler
D201803E.* - Wall-Hung Drinking Water Cooler
D201804E.* - Semi-Recessed Drinking Water Cooler
D201805E.* - Fully Recessed Drinking Water Cooler
D2019 Other Plumbing Fixture Details
D201901E.* - (Omitted)
D201902E.* - Emergency Eyewash Detail
D201903E.* - Wall Mounted Emergency Eyewash Detail
D201904 .* - (Omitted)
D201905E.* - Typical Water Hammer Panel Installation
D201906E.* - Freeze-Proof Yard Hydrant Detail
D201907E.* - Backflow Preventer Detail
D201908E.* - Washing Machine Hook-Up Detail
D201909E.* - Washing Machine Water Connection Detail
D201910E.* - (Omitted)
D201911E.* - Laundry Sink Drain Connection Detail

D202 Domestic Water Distribution

D2020 Misc. Details
D202001E.* - Water Meter Configuration (Less than 2 Inches)
D202002E.* - Water Turbine Meter Configuration (Greater than 6 Inches)
D202003E.* - Safety Valve Detail

D202004S.* - Dual Pump Hot Water Piping Schematic
D202005 .* - (Omitted)
D202006 .* - (Omitted)
D202007E.* - Typical Concrete Floor or Masonry Wall Penetration
D202008E.* - Typical Fire-Proof Framed Wall Penetration
D202009E.* - Typical Insulated Pipe Wall Penetration
D202010E.* - Piping Wall Penetration Detail
D202011E.* - Cast Iron Piping Building Penetration Detail
D202012S.* - Typical In-Line Pump Detail
D202013E.* - Typical Membrane Waterproof Floor Penetration Detail
D202014E.* - Grade Beam Pipe Penetration Detail
D202015E.* - Piping Thru Roof

D2021 Water Supply Piping Systems

D202101X.* - Water System Service Entrance for Bldgs. with Basements
D202102X.* - Water System Service Entrance for Bldgs. on Slabs
D202103S.* - Backflow Preventer Detail
D202104S.* - Domestic Hot Water Piping Schematic

D2022 Water Supply Plumbing Specialties

D202201X.* - Typical Wall Penetration Detail
D202202X.* - Pipe Sleeve Detail
D202203E.* - Trap Seal Primer Detail
D202204X.* - Wall Pipe Sleeve Detail
D202205E.* - Typical Air and Water Drop Detail
D202206X.* - Valve Box Detail
D202207X.* - Pipe Sleeve Thru Interior Wall
D202208X.* - Pipe Sleeve Thru Exterior Wall
D202209E.* - Thrust Block Details

D2023 Water Supply Equipment

D202301E.* - Typical In-Line Pump Detail
D202302E.* - (Omitted)
D202303E.* - Domestic Hot Water Circulating Pump
D202304E.* - (Omitted)
D202305E.* - Piping Wall Penetration Detail
D202306E.* - (Omitted)
D202307S.* - (Omitted)
D202308S.* - (Omitted)
D202309S.* - (Omitted)
D202310S.* - (Omitted)
D202311S.* - ICW Booster Pump Detail

D2024 Water Supply Insulation

D202401X.* - Flexible Pipe Insulation Detail

D2025 Electric Water Heater

D202501E.* - Floor Mounted Electric Water Heater
D202502E.* - (Omitted)
D202503E.* - Floor Mounted Electric Water Heater (Isometric)
D202504E.* - Domestic Electric Water Heater
D202505E.* - Wall Mounted Electric Water Heater

D2026 Gas Fired Water Heater

D202601E.* - Gas Fired Floor Mounted Water Heater (Isometric)
D202602S.* - (Omitted)
D202603E.* - Gas Fired Water Heater with Recirculating Loop
D202604E.* - Gas Fired Water Heater Connections
D202605 .* - (Omitted)
D202606E.* - Gas Fired Water Heater (Two Tank System)

D203 Sanitary Waste Systems

D2030 Misc. Details

D203001 .* - (Omitted)
D203002P.* - Typical Sump Pump Detail
D203003P.* - Sump Pump and Sump Pit Detail
D203004P.* - Sump Basin Detail
D203005P.* - Sump Basin Installed in Concrete Pit
D203006P.* - Sewage Injector Basin and Pit

D2031 Waste and Vent Piping Systems

D203100X.* - Vent Thru Roof Detail
D203101E.* - Waste/Vent Line Penetrating Communication Center

D2032 Waste Piping Specialties

D203201X.* - Dilution/Neutralization Basin Detail
D203202E.* - Dry Sump Detail

D2033 Waste Piping Equipment

D203301X.* - Floor Cleanout Detail

D203302X.* - Wall Cleanout Detail
D203303X.* - (Omitted)
D203304X.* - Sanitary Cleanout Floor Slab Detail
D203305X.* - Floor Drain Detail
D203306X.* - Typical Double Wall Drain Section
D203307E.* - Sump Pump Detail
D203308E.* - Floor Drain in Open Area
D203309E.* - (Omitted)
D203310E.* - (Omitted)
D203311 .* - (Omitted)
D203312E.* - Floor Cleanout for Finished Rooms
D203313E.* - Non-Clog Floor Drain with Sediment Bucket
D203314E.* - Wall Cleanout for Finished Rooms
D203315E.* - Typical Tub and Condensate Drain Detail
D203316E.* - Typical Exterior Cleanout Detail
D203317E.* - Typical Custom-Made Grease Interceptor Detail
D203318E.* - Typical Semi-Automatic Grease Interceptor
D203319E.* - Typical Semi-Automatic Grease Interceptor w/Draw-Off Valve
D203320E.* - Typical Enzymatic Grease Interceptor
D203321E.* - Typical Manually Operated Grease Interceptor

D2034 Waste Piping Insulation
D2035 Acid Waste Systems

D204 Rain Water Drainage Systems

D2040 Misc. Details
D204001E.* - Rain Leader Drop Detail
D204002E.* - Large Sump Roof Drain Detail
D204003E.* - Medium Sump Roof Drain Detail

D2041 Rain Water Drainage Piping Systems
D2042 Rain Water Drainage Specialties
D2043 Rain Water Drainage Insulation

D205 Special Plumbing Systems

D2050 Misc. Special Plumbing Details
D2051 Medical Gas Systems
D2052 Helium Gas Systems
D2053 Liquid Oxygen Systems
D2054 Vacuum Systems
D2055 Natural Gas Systems
D205501E.* - Corrosion Control Test Station
D205502P.* - Pressure Regulation Station Plan
D205503E.* - Insulating Flange Assembly
D205504E.* - Insulating Valve Assembly
D205505E.* - Underground Valve Detail - 6" and Larger
D205506E.* - Underground Valve Detail - 1" thru 4"
D205507E.* - Roof Curb for Gas Line Penetration
D205508E.* - Gas Meter and Regulator Connection
D205509E.* - Gas Meter Configuration
D205510X.* - Gas Valve and Valve Box
D205511E.* - Natural Gas Spigot Detail
D205512E.* - Metered Gas Service Entrance
D205513E.* - Gas Line Railroad Crossing Detail
D205514E.* - Gas Pressure Regulator
D205515E.* - Gas Meter and Regulator Detail
D205516E.* - Typical Gas Service Meter with By-pass
D205517E.* - Typical Anodeless Gas Meter Riser Detail
D205518E.* - Typical Gas Service Connection Detail
D2056 Liquified Petroleum Gas Systems
D2057 Deionized/Distilled Water Systems
D2058 Reverse Osmosis Systems
D2059 Fountain Equipment and Piping

D206 Compressed Air Systems

D2060 Misc. Compressed Air Details
D2061 Compressed Air Piping and Equipment
D206101E.* - (Omitted)
D206102E.* - Air Compressor Detail
D206103S.* - Compressed Air Outlet Detail
D206104E.* - Air Compressor Detail with Air Dryer
D206105 .* - (Omitted)
D206106E.* - Air Compressor Detail

D206107E.* - Typical Compressed Air Tool Station Detail
D206108S.* - Typical Utility Compressed Air Station Detail
D206109S.* - Breathing Air Station Detail
D206110E.* - Typical Horizontal Air Compressor Detail
D206111E.* - Typical Vertical Air Compressor Detail
D206112I.* - Breathing Air Compressor Frame Detail
D206113E.* - (Omitted)
D206114E.* - Vertical Instrument Air Compressor/System Detail

D2062 Compressed Air Legends and Schematics

D206201E.* - Compressed Air System Schematic Diagram
D206202S.* - (Omitted)
D206203S.* - (Omitted)
D206204S.* - (Omitted)
D206205S.* - (Omitted)
D206206S.* - Air Compressor Installation Diagram

D30 HEATING, VENTILATING, AND AIR CONDITIONING (HVAC) SYSTEMS

D301 Fuel Supply Systems

D3010 Misc. Fuel Supply Details

D301001S.* - Boiler Fuel Oil Flow Schematic

D3011 Oil Supply Systems

D3012 Gas Supply Systems

D3013 Coal Supply Systems

D302 Heat Generation Systems

D3020 Misc. Heat Generation Details

D302001E.* - High-Temperature Water Drain and Air Vent Detail
D302002E.* - (Omitted)
D302003E.* - Metal Flue Stack Detail
D302004S.* - (Omitted)
D302005E.* - Boiler Flue Connection Detail
D302006 .* - (Omitted)
D302007E.* - (Omitted)
D302008E.* - Flue Stack and Wall Penetration
D302009E.* - Steam Relief Valve Drip Pan Ell
D302010S.* - Typical Steamguard Detail
D302011S.* - Typical Pressure Reducing Set Detail
D302012E.* - Dripped Elbow-Safety Valve Vent Detail
D302013S.* - Simplex Condensate Pump Detail
D302014E.* - Trap Discharge Connection Detail
D302015S.* - (Omitted)
D302016S.* - (Omitted)
D302017S.* - (Omitted)
D302018S.* - (Omitted)
D302019E.* - Typical Flue Vent Detail
D302020S.* - End-of-Main Steam Trap Schematic
D302021S.* - Steam Pressure Reducing Station Schematic
D302022E.* - Cooling Well Detail
D302023E.* - (Omitted)
D302024E.* - Hot Vent Detail
D302025E.* - Relief Valve Piping Detail

D3021 Steam Boilers

D302101E.* - Steam Sectional Cast-Iron Forced-Draft Boiler Detail
D302102S.* - Low Pressure Steam Boiler Piping Detail

D3022 Hot Water Boilers

D302201E.* - (Omitted)
D302202E.* - (Omitted)
D302203E.* - (Omitted)
D302204E.* - (Omitted)
D302205S.* - Electric Hot Water Boiler Detail
D302206E.* - Steam Water-Tube Atmospheric Boiler Detail
D302207E.* - Domestic Hot Water Tank and Tank Heater with Steam Input
D302208S.* - Domestic Hot Water Schematic
D302209S.* - Domestic Hot Water Generator Schematic
D302210E.* - Vertical Hot Water Generator Connections
D302211S.* - Boiler Piping Schematic

D3023 Furnaces

D3024 Fuel-Fired Heaters

D302401E.* - (Omitted)
D302402S.* - Gas Fired Unit Heater Detail

D302403E.* - Gas Fired Make-Up Unit Heater Detail
D302404E.* - Boiler Stack Detail
D302405E.* - Typical Gas Fired Unit Heater Detail

D3025 Auxiliary Equipment

D302501E.* - Typical Make-Up Air Unit Detail
D302502 .* - (Omitted)
D302503S.* - Outdoor Control on Steam (Convertor Piping)
D302504S.* - Hot Water Generator - Steam Heated (Low Pressure)
D302505S.* - Hot Water Generator -Steam Heated (High Pressure)
D302506S.* - Steam Pressure Reducing Set

D303 Heat Rejection Systems

D3030 Misc. Heat Rejection Details

D3031 Absorption Chillers

D303101S.* - Absorption Chiller Piping Schematic
D303102E.* - Air-Cooled Chiller Piping Connection

D3032 Centrifugal Chillers

D303201E.* - Centrifugal Chiller Detail

D3033 Reciprocating Chillers

D3034 Rotary-Screw Chillers

D3035 Cooling Towers and Liquid Coolers

D303501E.* - Cross-Flow Cooling Tower Detail
D303502S.* - (Omitted)
D303503S.* - (Omitted)
D303504S.* - (Omitted)
D303505S.* - Cooling Tower Piping Schematic

D3036 Refrigerant Compressors and Condensers

D303601S.* - Refrigerant Piping Schematic

D3037 Heat Pumps

D304 Heat Distribution Systems

D3040 Misc. Heat Distribution Details

D304001E.* - Duct Hanger Detail
D304002X.* - Dielectric Flex Duct Connection for Roof Penetrations
D304003X.* - Duct Penetration Through Wall
D304004X.* - Typical SCIF Area Duct Installation Detail
D304005X.* - Typical Security Bars Installation Detail
D304006I.* - Typical Support Frame Detail
D304007E.* - (Omitted)
D304008E.* - Equipment Pad Detail
D304009E.* - Expansion Tank Support
D304010E.* - Vibration Isolator Detail
D304011X.* - Typical A/C Rooftop Spring Curb Mounting
D304012S.* - (Omitted)
D304013X.* - Security Grating Details
D304014S.* - (Omitted)
D304015E.* - Expansion Tank Detail
D304016E.* - Vertical Expansion Tank Detail
D304017S.* - (Omitted)
D304018S.* - (Omitted)
D304019S.* - (Omitted)
D304020I.* - Variable Volume Box Detail
D304021I.* - Fan Powered Variable Air Volume Box Detail
D304022X.* - Air Terminal Unit Mounting Detail
D304023I.* - Platform for Suspending Equipment from Roof Structure
D304024X.* - Restraints for Rigidly Mounted Mechanical Equipment
D304025S.* - Flash Tank Piping Detail
D304026E.* - Typical Expansion Tank Mounting Detail
D304027E.* - Expansion Tank Installation Detail
D304028S.* - Typical Refrigerant Piping Detail
D304029I.* - Refrigerant Piping Diagram
D304030S.* - (Omitted)
D304031S.* - (Omitted)
D304032S.* - (Omitted)
D304033S.* - (Omitted)
D304034E.* - Refrigerant Line Penetration Detail
D304035E.* - Manual Damper Detail
D304036E.* - Typical Splitter Damper Detail
D304037I.* - Typical Branch Take-off Fitting
D304038E.* - Typical Pipe Stand Support Leg
D304039E.* - Pipe and Conduit Roof Penetration
D304040E.* - Typical Relief Vent Detail

D304041E.* - Relief Vent Detail

D3041 Air Distribution Systems

D304101E.* - Supply Air Diffuser Detail -Plan and Elevation
D304102X.* - Supply Air Diffuser Detail Section
D304103E.* - Propeller Fan Detail
D304104E.* - Wall Fan Detail
D304105E.* - Penthouse Louver Detail
D304106E.* - Relief or Intake Vent Detail
D304107E.* - Louver/Damper Detail
D304108E.* - (Omitted)
D304109E.* - (Omitted)
D304110X.* - (Omitted)
D304111E.* - Air Curtain Detail
D304112E.* - (Omitted)
D304113E.* - (Omitted)
D304114E.* - Duct Roof Penetration and Support Detail
D304115P.* - (Omitted)
D304116I.* - VAV Terminal Unit Detail
D304117E.* - Access Door Swing Detail for Air Handling Units
D304118E.* - Typical Fan Coil Unit Detail
D304119E.* - Typical Branch Connection
D304120X.* - (Omitted)
D304121E.* - Duct Access Doors
D304122X.* - Fire Damper with Fusible Link
D304123X.* - Terminal Unit Duct Take-Off
D304124E.* - Gas Fired Air Handling Unit
D304125E.* - Centrifugal In-Line Fan Detail
D304126S.* - (Omitted)
D304127S.* - (Omitted)
D304128E.* - Fancoil Detail
D304129E.* - Heating and Ventilating Unit - Ceiling Type
D304130E.* - Flexible Duct to Ceiling Diffuser
D304131E.* - Linear Slot Diffuser Detail
D304132I.* - Fan Powered VAV Detail
D304133I.* - VAV Unit with Reheat Coil
D304134E.* - (Omitted)
D304135I.* - Typical Ceiling Outlet Detail
D304136I.* - Typical Splitter Damper Detail
D304137P.* - Typical Turning Vane Detail
D304138P.* - Typical Splitter Damper Plan Detail
D304139E.* - Ceiling Diffuser Connection Detail
D304140E.* - Typical Gooseneck Detail
D304141I.* - Typical Ceiling Diffuser Detail
D304142E.* - Heavy Duty Supply and Exhaust Duct
D304143E.* - Typical Flexible Connection Detail
D304144I.* - Typical Duct Elbow Detail
D304145I.* - Typical Branch Take-Off Detail
D304146P.* - Transfer Duct Detail
D304147E.* - Return Air Security/Sound Treatment
D304148I.* - Typical VAV Terminal Unit
D304149S.* - (Omitted)
D304150S.* - (Omitted)
D304151E.* - (Omitted)
D304152E.* - Typical Roof Supply Fan Detail
D304153E.* - (Omitted)
D304154E.* - Combination Louver/Damper Detail
D304155E.* - Typical Wall Mounted Ventilation Fan with Motorized Dampers
D304156E.* - Intake Air Penthouse Detail

D3042 Steam Distribution Systems

D304201E.* - Steam Safety Relief Valve Detail
D304202E.* - Steam Building Supply Detail
D304203S.* - Steam Pressure Reducing Station Detail
D304204E.* - Steam Relief Valve with Drip Pan
D304205S.* - Low Pressure Steam Drip and Rise Detail
D304206S.* - Horizontal Steam Unit Heater Detail
D304207S.* - (Omitted)
D304208S.* - (Omitted)
D304209S.* - Steam Coil Piping Detail
D304210S.* - Steam Duct Humidifier Detail
D304211X.* - Steam Line Wall Penetration Detail
D304212S.* - Steam Plate Coil Piping Detail
D304213S.* - Vertical Steam Unit Heater Detail
D304214S.* - Steam Trap Installation
D304215S.* - Steam Pressure Reducing Station

D3043 Hydronic Distribution Systems

D304301E.* - Condenser Water Pump Detail

D304302E.* - Duplex Condensate Pump and Receiver Detail
D304303E.* - End Suction Pump, Makeup Water, and Expansion Tank
D304304E.* - (Omitted)
D304305E.* - Horizontal Split-Case Water Pump Detail
D304306E.* - Vertical In-Line Pump Detail
D304307E.* - Simplex Condensate Pump and Receiver Detail
D304308X.* - Pipe Floor Slab Penetration Detail
D304309X.* - Wall Pipe Penetration Detail
D304310E.* - Water Treatment One-Shot Feeder Detail
D304311E.* - Typical Computer Room Unit Piping
D304312E.* - (Omitted)
D304313E.* - (Omitted)
D304314S.* - Horizontal Hot Water Unit Heater Schematic
D304315X.* - Condensate Drain Dry-Well Detail
D304316S.* - Flash Tank Piping Detail
D304317S.* - Vertical In-Line Pump Detail
D304318S.* - (Omitted)
D304319S.* - Vertical Hot Water Unit Heater Piping Detail
D304320S.* - Close-Coupled Horizontal In-Line Pump Detail
D304321E.* - Typical Connection to Floor Mounted Single Suction Water Pumps
D304322E.* - (Omitted)
D304323E.* - Expansion Tank - 0-100 Gals
D304324E.* - Condensate Drain Trap Detail
D304325E.* - (Omitted)
D304326E.* - (Omitted)
D304327E.* - In-Line Centrifugal Pump
D304328S.* - Duplex Condensate Pump Connection Detail
D304329E.* - End Suction Pump Detail
D304330E.* - Chemical Feeder Detail
D304331E.* - Chilled Water Piping Diagram
D304332S.* - Pump Connection Detail
D304333S.* - (Omitted)
D304334E.* - Floor Mounted Pump Detail
D304335E.* - Wall Mounted Expansion Tank Detail
D304336E.* - Wall Mounted Expansion Tank Detail (Endview)
D304337E.* - (Omitted)
D304338E.* - Typical Make-Up Water Spool Detail
D304339P.* - Duplex Condensate Pump Detail
D304340E.* - Typical Chemical Feeder Detail

D3044 Exhaust and Ventilation Systems

D304401X.* - Roof Mounted Centrifugal Exhaust Fan Detail
D304402X.* - Exhaust Hood Detail
D304403E.* - Engine Exhaust Floor Outlet Detail
D304404E.* - Fuel Tank Exhaust Fan Detail
D304405E.* - Exhaust Receptor Detail
D304406E.* - (Omitted)
D304407X.* - Exhaust Penthouse
D304408X.* - Typical Relief Vent Detail
D304409X.* - Wall Mounted Exhaust Fan Detail
D304410X.* - Ceiling Mounted Exhaust Fan Detail
D304411E.* - Exhaust Fan Detail
D304412E.* - Ceiling Exhaust Fan Detail
D304413X.* - Centrifugal Wall Exhaust Fan Detail
D304414X.* - Propeller Exhaust/Supply Fan Detail
D304415X.* - Roof Mounted Exhaust & Supply Fan Detail
D304416E.* - Ceiling Exhaust Fan Detail
D304417E.* - Roof Mounted Exhaust Fan Detail
D304418S.* - (Omitted)
D304419E.* - Exhaust Hood Detail
D304420E.* - Vehicle Exhaust Reel
D304421E.* - Radial Arm Saw Dust Collection System
D304422E.* - (Omitted)
D304423E.* - Dishwasher Hood Detail
D304424E.* - Range and Griddle Hood Detail
D304425X.* - Power Roof Ventilator Detail
D304426E.* - Upblast Power Roof Ventilator Detail
D304427 .* - (Omitted)
D304428X.* - Wall Mounted Exhaust Fan

D304429E.* - Ceiling Mounted Exhaust Fan
D304430E.* - Relief Hood Detail
D304431E.* - (Omitted)
D304432X.* - Inlet or Exhaust Louvered Penthouse
D304433E.* - Exhaust Hood Detail
D304434 .* - (Omitted)
D304435E.* - (Omitted)
D304436S.* - (Omitted)
D304437E.* - (Omitted)
D304438E.* - Typical Roof Mounted Exhaust Vent
D304439E.* - Ventilation/Exhaust Opening Detail
D304440E.* - Typical Gravity Ventilator Detail
D304441E.* - Ceiling Exhaust Fan Detail

D305 Heat Transfer

D3050 Misc. Heat Transfer Details

D305001E.* - Typical Unit Convector Detail

D3051 Heat Exchangers

D305101S.* - (Omitted)
D305102E.* - Single Tier Radiator
D305103S.* - Typical Heat Exchanger Piping Schematic
D305104S.* - (Omitted)
D305105S.* - Heat Exchanger Connection Detail

D3052 Package Terminal Air Conditioning Systems (PTAC)

D3053 Split Systems

D3054 Air Coils

D305401E.* - Air Handling Unit Coil Piping
D305402E.* - Refrigerant Coil Detail
D305403E.* - Horizontal Fan Coil Unit Detail
D305404E.* - Typical Fan Coil Unit Detail
D305405E.* - Air Handling Unit Stacked Coil Piping
D305406E.* - VAV Heating Coil Detail
D305407E.* - (Omitted)
D305408S.* - (Omitted)
D305409E.* - Chilled Water Coil Connection (3-Way Mixing Valve)
D305410E.* - Typical Connections to Chilled Water Coil with Circulating Pump
D305411E.* - Stacked Coils Detail
D305412E.* - Hot Water Coil Connection (3-Way Mixing Valve)
D305413E.* - Hot Water Coil Connection (2-Way Mixing Valve)
D305414S.* - Typical Fan Coil Unit Piping Schematic
D305415S.* - Typical Hot Water Coil Piping Schematic
D305416S.* - Typical Heating Only Fan Coil Unit Piping Schematic
D305417S.* - Typical Steam Coil Piping Detail
D305418E.* - Typical Fan Coil Unit Piping Schematic
D305419S.* - Typical Hot Water Preheat Coil Piping Schematic
D305420S.* - Chilled Water Coil Piping Schematic

D3055 Humidifiers

D305501S.* - Typical Humidifier Condensate Return Detail
D305502 .* - (Omitted)
D305503P.* - Humidifier Piping Detail

D3056 Dehumidifiers

D3057 Terminal Heat Transfer Units

D305701E.* - Vertical Hot Water Unit Heater Detail
D305702E.* - Hot Water Cabinet Unit Heater Detail
D305703E.* - Fin Tube Radiator Detail
D305704E.* - Radiant Heater & Flue Pipe Detail
D305705S.* - (Omitted)
D305706E.* - Hot Water Unit Heater Detail
D305707E.* - Electric Unit Heater Detail
D305708E.* - Blow-Down Hot Water Unit Heater Detail
D305709E.* - Typical Convector Piping Detail
D305710S.* - Fin Tube Convector Piping Schematic
D305711S.* - (Omitted)
D305712E.* - Typical Connections to Unit Heaters
D305713S.* - (Omitted)
D305714S.* - (Omitted)
D305715E.* - Typical Hot Water Baseboard Convector Piping

D6014 Fuel Storage Tanks

D601401X.* - Section Thru 2500 Gal. Underground Tank

D601402P.* - (Omitted)

D601403X.* - Section Thru 4,000 Gal. Underground Tank

D601404X.* - Section Thru 5,000 Gal. Underground Tank

D601405X.* - (Omitted)

D601406X.* - (Omitted)

D601407S.* - Waste Oil Storage Tank Detail

D601408E.* - Fuel Storage Tank Detail

D6015 Day Tanks

D601501E.* - 500 Gal. Daytank

D601502E.* - Fuel Oil Daytank Detail

D602 Auxiliary/Emergency Power

D6020 Misc. Details

D602001X.* - Exhaust Pipe Wall Penetration

D602002S.* - Typical Fuel Flow Schematic

D602003X.* - Vent Pipe Wall Penetration

D602004X.* - Exhaust Pipe Roof Penetration

D602005E.* - Engine/Generator Fuel System Diagram

D6021 Generator Sets

D602101E.* - 100 kW Diesel Generator Set with Sub-base Tank

D6022 Mufflers/Silencers

D603 Supports

D6030 Misc. Piping Supports

D603001E.* - U-Bolt Pipe Support

D603002E.* - C-Rail Pipe Support

D603003E.* - Z-Bar Pipe Support

D603004E.* - Pipe Support Attached from Ceiling

D603005E.* - Spring Isolated Hanger Detail for Insulated Pipe

D603006E.* - Clevis Hanger Detail for Insulated Pipe

D603007E.* - Pipe Anchor Detail

D603008E.* - Chilled Water Pipe Support Detail

D603009E.* - Wall Hung Steam or Condensate Pipe Support Detail

D603010X.* - Chilled Water Horizontal Pipe Support

D603011X.* - Unit or Tank Mounting Bracket Detail

D603012E.* - C-Strut Wall Support Detail

D603013E.* - Pipe Anchoring

D603014E.* - Pipe Support Detail

D603015E.* - (Omitted)

D603016E.* - Wall Hung Pipe Support for Insulated Pipe

D603017E.* - Ceiling Hung Clevis Hanger Detail for Insulated Pipe

D603018 .* - (Omitted)

D603019 .* - (Omitted)

D603020 .* - (Omitted)

D603021E.* - Exterior Pipe Support Detail

D603022X.* - Threaded Rod Attachments From Metal Deck Concrete Slab

D603023X.* - Pipe & Suspended Equipment Support From Metal Deck Concrete Slab

D603024X.* - Wall Anchor Detail

D603025E.* - (Omitted)

D603026E.* - Straight Anchor Detail

D603027E.* - 45o Angle Anchor Detail

D603028E.* - 90o Angle Anchor Detail

D603029E.* - (Omitted)

D6031 MSS Piping Supports

D6032 Seismic Supports

D603201E.* - Seismic Restraint For Lateral Load

D603202E.* - Seismic Angle Brace Detail

D603203E.* - Seismic Restraint For Mechanical Equipment

D603204E.* - Typical Seismic Restraint and Supports for Equipment

D603205E.* - Seismic Sway Brace Detail for Insulated Piping

D603206E.* - Seismic Details for Sway Bracing

D603207E.* - Typical Seismic Pipe Bracing Detail

D603208E.* - Typical Sway Brace Detail

D603209E.* - (Omitted)

D603210E.* - (Omitted)

D603211E.* - Seismic Brace Details

D603212E.* - Seismic Restraints for Lateral & Vertical Loads (Neoprene)

D6033 Fire Suppression Supports

D604 Valves
D6040 Misc. Valve Details

D605 Hydropower, Locks, and Dams
D6050 Misc. Civil Works
D6051 Hydropower Equipment
D6052 Locks and Dams

E EQUIPMENT AND FURNISHINGS

E10 EQUIPMENT
E101 Commercial Equipment
E1010 Misc. Commercial Equipment
E1011 Security and Vault Equipment
E1012 Teller and Service Equipment
E1013 Registration Equipment
E1014 Checkroom Equipment
E1015 Mercantile Equipment
E1016 Commercial Laundry and Dry Cleaning Equipment
E1017 Vending Equipment
E1018 Office Equipment

E102 Institutional Equipment
E1020 Misc. Institutional Equipment
E1021 Ecclesiastical Equipment
E1022 Library Equipment
E1023 Theater and Stage Equipment
E1024 Instrumental Equipment
E1025 Audio-Visual Equipment
E1026 Detention Equipment
E1027 Laboratory Equipment
E1028 Medical Equipment
E1029 Mortuary Equipment

E103 Vehicular Equipment
E1031 Vehicular Service Equipment
E103101 .* - (Omitted)
E103102E.* - Free Standing Parts Washer Cabinet
E1032 Parking Control Equipment
E1033 Loading Dock Equipment

E104 Other Equipment
E1041 Maintenance Equipment
E1042 Solid Waste Handing Equipment
E1043 Food Service Equipment
E1044 Residential Equipment
E1045 Unit Kitchens
E1046 Darkroom Equipment
E1047 Athletic, Recreational, and Therapeutic Equipment
E1048 Planetarium/Observatory Equipment
E1049 Agricultural Equipment

E20 FURNISHINGS
E201 Fixed Furnishings
E2010 Misc. Fixed Furnishings
E2011 Fixed Artwork
E2012 Fixed Casework
E2013 Window Treatment
E2014 Fixed Floor Grilles and Mats
E2015 Fixed Multiple Seating
E2016 Fixed Interior Landscaping

E202 Movable Furnishings
E2020 Misc. Movable Furnishings
E2021 Movable Artwork
E2022 Furniture and Accessories
E2023 Movable Rugs and Mats
E2024 Movable Multiple Seating
E2025 Movable Interior Landscaping

F OTHER BUILDING CONSTRUCTION

F10 SPECIAL CONSTRUCTION
F101 Special Structures
F1010 Misc. Special Structures
F1011 Air Supported Structures
F1012 Pre-Engineered Structures

F102 Integrated Construction
F1020 Misc. Integrated Construction Details
F1021 Integrated Assemblies
F1022 Special Purposed Rooms

F103 Special Construction Systems
F1030 Misc. Special Construction System Details

F1031 Sound, Vibration, and Seismic Construction
F1032 Radiation Protection
F1033 Special Security Systems

F104 Special Facilities
F1040 Misc. Special Facility Details
F1041 Aquatic Facilities
F1042 Ice Rinks
F1043 Site Constructed Incinerators
F1044 Kennels and Animal Shelters
F1045 Liquid and Gas Storage Tanks

F105 Special Controls and Instrumentation
F1050 Misc. Special Controls and Instrumentation Details
F1051 Recording Instrumentation
F1052 Building Automation Systems
F1053 Fire Suppression and Supervisory Systems

F20 SELECTIVE DEMOLITION
F201 Building Elements Demolition
F2011 Minor Demolition for Remodeling
F2012 Selective Structural Demolition

F202 Hazardous Components Abatement

G BUILDING SITEWORK

G10 SITE PREPARATION
G101 Subsurface Investigation
G1011 Standard Penetration Tests
G1012 Seismic Investigation

G102 Site Clearing
G1021 Sod Stripping
G1022 Clearing and Grubbing
G1023 Shrub and Tree Removal

G103 Site Demolition and Relocations
G1031 Building Demolition
G1032 Site Elements Demolition
G1033 Structure Relocation
G1034 Utility Relocation

G104 Site Earthwork
G1041 Grading
G1042 Excavating, Backfilling, and Compacting
G1043 Soil Stabilization
G1044 Slope Protection and Erosion Control
G1045 Earth Dams

G105 Hazardous Waste Removal

G20 SITE IMPROVEMENTS
G201 Roadways
G2011 Roadway Base Courses
G2012 Flexible Roadway Pavement
G2013 Roadway Unit Pavers
G2014 Rigid Roadway Paving
G2015 Roadway Curb and Gutter
G2016 Roadway Appurtenances

G202 Parking Lots
G2021 Parking Lot Base Courses
G2022 Flexible Parking Lot Pavement
G2023 Parking Lot Unit Pavers
G2024 Rigid Parking Lot Paving
G2025 Parking Lot Curb and Gutter
G2026 Parking Lot Appurtenances
G202600E.* - Typical Bollard Detail

G203 Pedestrian Paving
G2031 Pedestrian Paving Base Courses
G2032 Flexible Pedestrian Pavement
G2033 Pedestrian Unit Pavers
G2034 Rigid Pedestrian Paving
G2035 Exterior Steps

G204 Site Development
G2041 Fountains
G2042 Fences and Gates
G2043 Recreational and Sports Facilities
G2044 Site and Street Furnishings
G2045 Exterior Signs
G2046 Footbridges and Underpasses

G2047 Flagpoles
G2048 Covers and Shelters

G205 Landscaping
G2051 Irrigation Systems
G2052 Shrub and Tree Transplanting
G2053 Soil Preparation
G2054 Lawns and Grasses
G2055 Trees, Plants, and Ground Covers
G2056 Landscape Maintenance

G206 Hazardous Waste Remediation
G2061 Containment Systems
G2062 Extraction/Leachate Collection Systems
G2063 Monitoring Systems
G2064 Decomtamination Systems

G30 SITE PLUMBING UTILITIES
G301 Site Water Supply and Distribution Systems
G3011 Water Wells
G3012 Site Domestic Water Distribution
G301200E.* - Water Main Connection Detail
G301201E.* - Water Meter Installation Detail
G301202E.* - Typical Branch Line Valve Installation Detail
G301203E.* - Typical Thrust Block Installation Detail
G301204E.* - Typical Valve Box Detail
G301205E.* - Tapping Sleeve and Valve Installation Detail
G301206E.* - Post Indicator Valve Detail
G301207E.* - Typical Motorized Valve and Valve Box Detail
G3013 Site Fire Protection Water Distribution Systems
G3014 Site Comtaminated Water Distribution

G302 Site Sanitary Sewer Systems
G3021 Site Sanitary Sewerage
G302101E.* - Typical Oil Separator Detail
G3022 Septic Systems
G3023 Site Sanitary Sewerage Equipment
G3024 Sewage Ponds

G303 Site Storm Sewer Systems
G3031 Site Storm Sewerage
G3032 Site Storm Sewer Appurtenances
G3033 Site Storm Sewerage Equipment
G3034 Storm Water Ponds and Reservoirs

G304 Site Fuel Distribution Systems
G3041 Site Gas Distribution Systems
G3042 Site Oil Distribution Systems
G3043 Other Site Fuel Distribution Systems

G305 Site Special Plumbing Systems
G3051 Industrial Waste Systems
G3052 Other Special Site Plumbing Systems

G40 SITE HEATING, VENTILATING, AND AIR CONDITIONING (HVAC) UTILITIES
G401 Site Steam Distribution Systems
G4010 Misc. Site Steam Distribution Systems
G401001X.* - Steam Manhole Detail
G4011 Site Steam Piping Systems
G401101P.* - Valve Manhole
G401102E.* - Access Ladder
G401103E.* - Isolation Flange
G401104E.* - Valve and Pipe Support
G401105P.* - (Omitted)
G401106P.* - Open Grating Cover Plan
G401107X.* - Angle Support for Grating
G401108X.* - Structural Support for Grating
G401109P.* - Grating Support Locations
G401110P.* - Checker Plate Cover Details
G401111P.* - Raised Cover Plate
G401112X.* - Raised Cover Plate - Section A-A
G401113X.* - Raised Cover Plate - Section B-B
G401114X.* - Raised Cover Plate - Section C-C
G401115X.* - Detail 1 - Hinge Detail
G401116E.* - Lifting Lug
G401117E.* - Handle
G401118E.* - (Omitted)
G401119P.* - Concrete Cover Plan
G401120X.* - Concrete Cover Detail
G401121E.* - Typical Gooseneck Detail

G602 Other Site Systems and Equipment

G6021 Contaminant Processing Systems and Equipment

6 Inch-Pound Library

The following pages contain images of the CADD Details Library. The details presented are accessible through the Center-supplied retrieval programs. Loading instructions are provided as part of the electronic media. Appendix C contains a form for recommending changes to specific details within the CADD Details Library.

Note: Because these details represent existing details used within the DoD, it should be noted that the level/layer assignments, colors, and line weights for some details do not meet the prescribed standards set forth in this manual. Subsequent versions of the CADD Details Library will continue to convert details to meet the prescribed standards.

Appendix A
Abbreviations for CADD Details Library

Abbreviation	Definition
(N)	new
(R)	relocated item
<	angle
1/4 RD	quarter round
A/C	air conditioning
A.C.	alternating current
A.L.	active leaf
AB	anchor bolt
ABV	above
ACC	access
ACI	American Concrete Institute
ACPL	acoustical plaster
ACR	acrylic plastic
ACSR	aluminum conductor steel reinforced
ACST	acoustic
ACU	air conditioning unit
AD	access door
ADD	addendum
ADH	adhesive
ADJ	adjacent, adjunct
ADJT	adjustable
ADO	automatic door operator
AFF	above finished floor
AGG	aggregate
AHU	air handling unit
AI	area inlet
AIC	amps interrupting capacity (sym rms)
AISC	American Institute of Steel Construction
ALT	alternate
ALUM	aluminum

Abbreviation	Definition
AMB	ambient
AMP	ampere
ANC	anchor, anchorage
ANOD	anodized
ANSI	American National Standards Institute
AP	access panel
APPD	approved
APPROX	approximate
ARCH	architect(ural)
ARI	American Refrigeration Institute
ASB	asbestos
ASC	above suspended ceiling
ASPH	asphalt
AT, ACT	acoustical (ceiling) tile
ATC	acoustical tile ceiling
AUTO	automatic
AVG	average
AWC	acoustical wall covering
AWG	American wire gauge
B	bins
B.M.	bench mark
BATT INSUL	batt insulation
BBD	bulletin board
BC	bookcase
BD	board
BDY	boundary
BE	bench
BEJ	brick expansion joint
BEL	below
BIT	bituminous

Abbreviation	Definition
BJT	bed joint
BL	building line
BLDG	building
BLK	block
BLKG	blocking
BM	beam
BO	bottom of
BOT	bottom
BP	back plaster(ed)
BPL	bearing plate
BPR	bed pan and urinal rack
BRCG	bracing
BRDG	bridging
BRG	bearing
BRK	brick
BRKT	bracket
BRZ	bronze
BS	both sides
BSMT	basement
BT	bent
BTU	British thermal unit
BTUH	btu per hour
BTW	between
BUR	built-up roofing
BVL	beveled
BW	both ways
C to C	center to center
C.B.	circuit breaker
C.I.	curb inlet
C.T.	current transformer
CAB	cabinet
CAD	cadmium
CAP	capacity
CB	catch basin
CCT	cubicle curtain track
CCU	coronary care unit
CE	cover elevation
CEM	cement
CER	ceramic
CFI	conductive flooring
CFL	counterflashing
CFM	cubic feet per minute
CFT	cubic foot
CG	corner guard

Abbreviation	Definition
CHAM	chamfer
CHBD	chalkboard
CHIM	chimney
CHT	ceiling height
CI	cast iron
CIPC	cast-in-place concrete
CIR	circular
CIRC	circumference
CJT	control joint
CKD	checked
CKT	circuit
CL WG	clear wire glass
CL	center line
CLG	ceiling
CLGL	clear glass
CLKG	caulking
CLL	contract limit line
CLO	closet
CLOS	closed
CLR	clear(ance)
CLS	closure
CM	centimeter(s)
CMP	corrugated metal pipe
CMT	ceramic mosaic (tile)
CMU	concrete masonry unit
CND	conduit (for raceway-elec. sheets)
CNL	conductive neoprene latex
CNTR	counter
CO	cleanout
CO2	carbon dioxide
COL	column
COM	common
COMB	combustion
COMP	compress(ed)(ion)(ible)
COMPO	composite, composition
COMPT	compartment
CONC	concrete
CONN	connection
CONST	construction
CONST JT	construction joint
CONT	continue (ous)
CONTR	contract(or)
COR	corner

Abbreviation	Definition
CORR	corrugated
CORR.	corridor
COV	covered
CP, CPT	carpet(ed)
CPL	cement plaster
CPR	copper
CPS	cycles per second (hertz)
CR	chromium (plated)
CRES	corrosive resistant steel
CRG	cross grain
CRS	course(s)
CSK	countersink, countersunk
CSMT	casement
CST	cast stone
CT	ceramic tile
CTL	carpet tile
CTP	ceramic tile panel
CTR	center
CTSK	countersunk screw
CU	condensing unit
CU YD	cubic yards
CUH	cabinet unit heater
CV	ceiling vent
CVH	conductive vinyl homogeneous (sheet type)
CW	cold water
CYL	cylinder
d	penny (as in nail - 10d)
D	datum
D.H.	double hung
D&M	dressed and matched
DA	double acting
DB	dry bulb
DBL	double
DC	dental casework
DCJ	doweled control joint
DCJT	dummy control joint
DCL	door closer
DEG	degree
DEM	demolish
DEP	depressed
DEPR	depression
DEPT	department
DF	drinking fountain

Abbreviation	Definition
DH	duct heater
DIA	diameter
DIAG	diagonal
DIM	dimension
DISC	disconnect
DISP	dispenser
DIST	distribution
DIV	division
DL	dead load
DMT	demountable
DN	down
DP	dampproofing
DPR	damper
DR	door
DRB	drainboard
DRN	drain
DS	downspout
DSB	double strength “b” quality glass
DT	drain tile
DTA	dovetail anchor
DTL, DET	detail
DTS	dovetail anchor slot
DW	dumbwaiter
DWG	drawing
DWGS	drawings
DWLS	dowels
DWR	drawer
DX	direct expansion
E	east
E.P.	electric panelboard
EA	exhaust air
EA.	each
EAT	entering air temperature
EB	expansion bolt
EEG	electro encephalographic
EF	each face
EJ	expansion joint
EKG	electrocardiograph
EL, ELEV	elevation - grade or building
ELEC	electric or electrical
EMD	estimated maximum demand
EMER	emergency
ENCL	enclose(ure)

Abbreviation	Definition	Abbreviation	Definition
ENT	ear, nose, and throat	FH	flathead or flushhead
ENTR	entrance, entering	FHC	fire hose cabinet
EP	explosion proof	FHMS	flathead machine screw
EPY	epoxy coating	FHR	fire hose rack
EQ	equal	FHS	fire hose station
EQUIP	equipment	FHWS	flathead wood screw
ESC	escalator	FI	film illuminator
EST	estimate(d)	FIG	figure
EWC	electric water cooler	FIN	finish(ed)
EWT	entering water temperature	FIX	fixture
EXCA	excavate	FJT	flush joint
EXD	exit device	FL	floor
EXH	exhaust	FLASH	flashing
EXIST	existing	FLCO	floor cleanout
EXMP	expanded metal plate	FLEX	flexible
EXP	exposed, expansion	FLG	flooring
EXPL	explosion	FLR	floor
EXPN	expansion	FLUOR	fluorescent
EXS	extra strong	FN	fence
EXT	exterior	FOC	face of concrete
F	Fahrenheit	FOF	face of finish
F.D.	fire damper	FOM	face of masonry
F.H.	fire hydrant	FOS	face of studs
FA	fire alarm	FP	fire partition
FAC	fire apparatus closet	FPL	floor plate
FAI	fresh air intake	FPM	feet per minute
FAS	fasten(er)	FPRF	fireproof
FB	face brick	FR	frame(d)(ing)
FBD	fiberboard	FRA	fresh air
FBO	furnished by others	FRC	fire-resistant coating
FBRK	fire brick	FRG	forged
FC	foot-candle	FRT	fire-retardant
FCG	facing	FS	full size
FCJ	floor construction joint	FT	feet
FCU	fan coil unit	FTG	footing
FD	floor drain	FUR	furr(ed)(ing)
FDN	foundation	FUT	future
FE	fire extinguisher	FW	fire water
FEB	fire extinguisher bracket	FWC	fabric wall covering
FEC	fire extinguisher cabinet	G	gas
FF	factory finish	GA	gage or gauge
FFE	finished floor elevation	GAL	gallon(s)
FFL	finished floor line	GALV	galvanized
FGL, F.G.	fiberglass	GB	grab bar

Abbreviation	Definition
GC	general contract(or)
GCMU	glazed concrete masonry units
GCO	ground cleanout
GEN	general
GF	ground face
GFE	government-furnished equipment
GFE/CI	government-furnished equipment contractor installed
GFI	ground fault interrupter
GI	galvanized iron
GKT	gasket(ed)
GL	glass, glazing
GLB	glass block
GLF	glass fiber
GND	ground
GOVT	government
GP	galvanized pipe
GPDW	gypsum drywall
GPL	gypsum lath
GPM	gallons per minute
GPPL	gypsum plaster, finish floor
GPT	gypsum tile
GR	grade(ing)
GRN	granite
GRS	galvanized rigid steel conduit
GRTG	grating
GSS	galvanized steel sheet
GST	glazed structural tile
GSU	glazed structural units
GT	grout
GVL	gravel
GWB	gypsum wallboard
GWT	glazed wall tile
GYP	gypsum
H.D.	heavy duty
H.M.	hollow metal
H'CAP	handicapped
HAC	housekeeping aide's closet
HB	hose bibb
HBD	hardboard
HC	hollow core
HCD	halon containment damper
HD	head

Abbreviation	Definition
HDR	header
HDRL	handrail
HDW	hardware
HES	high early-strength cement
HH	handhole
HIP	high pressure
HJT	head joint
HK	hook(s)
HOR	horizontal
HP	horsepower
HPT	high point
HR	hour
HS	high strength
HSGYP	high-strength gypsum plaster
HT	height
HTG	heating
HTR	heater
HVAC	heating, ventilating and air conditioning
HWD	hardwood
HWH	hot water heater
HX	hexagonal
HYD	hydraulic
HZ	hertz
I	iron
I.D.	inside diameter
IC	intercom
ICU	intensive care unit
IES	illuminating engineering society
ILK	interlock
IN	inch
INCIN	incinerator
INCL	include(d)(ing)
INSC	insulating concrete
INSF	insulating fill
INSUL	insulation
INSUL'D	insulated
INT	interior
INTM	intermediate
INV	invert(ed)
IP	iron pipe
IPS	iron pipe size
I.P.S.	inside pipe size

Abbreviation	Definition
IV	intravenous
JB	junction box
JC	janitor's closet
JCT	junction
JF	joint filler
JST	joist
JT	joint
KCM	kilo circular mil
KCPL	Keene's cement plaster
KIP	kilopound (1000 pounds)
KIT	kitchen
KL	key lock
KO	knockout
KPL	kickplate
KV	kilovolts
KVA	kilovolt amperes
KVAR	kilovolt amperes reactive
KW	kilowatt
L	lumen
L.H.	left hand(ed)
LAB	laboratory
LAD	ladder
LAM	laminate(d)
LAT	leaving air temperature
LAU	laundry
LAV	lavatory
LB	lag bolt
LBL	label
LBR	lumber
LBS	pounds
LC	light control
LD	load
LDG	loading
LG	length
LIN	linear
LIS	lawn irrigation system
LKR	locker
LL	live load
LLD	lead-lined door
LMS	limestone
LNTL	lintel
LONG	longitudinal
LP	lightproof
LPD	lightproof door
LPS	lightproof shade
LPT	low point
LR	living room
LT WT	lightweight
LT	light
LTG	lighting
LVR	louver
LWC	lightweight concrete
LWT	leaving water temperature
M	meter(s)
M&B	matched and beaded
MACH	machine
MAS	masonry
MAX	maximum
MB	machine bolts
MBR	member
MCJ	masonry control joint
MCO	metal-cased opening
MDS	metal divider strip
MECH	mechanic(al)
MED	medium
MEDCAB	medical cabinet
MER	mechanical equipment room
MES	metal edge strip
MET	metal
MFD	metal floor decking
MFG	manufacturing
MFR	manufacture(er)
MGT	matte-glazed tile
MG	motor generator
MH	manhole
MI	malleable iron
MIN	minimum
MIR	mirror
MISC	miscellaneous
ML	metal lath
MLDG	moulding
MM	millimeter(s)
MMB	membrane
MNIC	material not in contract (installation by contractor)
MO	masonry opening
MOD	modular
MOD.	modified

Abbreviation	Definition	Abbreviation	Definition
MONO	monolithic	OHMS	ovalhead machine screw
MOT	motor	OHWS	ovalhead wood screw
MOV	movable	OJ	open-web joist
MP	movable partition	OP	opaque
MR	mop receptor	OPH	opposite hand
MRB	marble	OPNG	opening
MRD	metal roof decking	OPP	opposite
MS	machine screws	OPS	operations
MSTC	mastic	OR	observation riser
MTD	mount(ed)(ing)	OS & Y	outside screw and yoke
MTFR	metal furring	OT	occupational therapy
MTHR	metal threshold	OW	observation window
MTL	material(s)	P	pole
MULL	mullion	P.L.	property line
MWK	millwork	P.S.	pressed steel
N	north	PA	public address
N.C.	normally closed	PAR	parallel
N.L.	neoprene latex	PART'N(S)	partition(s)
N.O.	normally open	PB	panic bar
N'REQD	not required	PBD	particle board
NAT	natural	PBPU	patient's bedside power unit
NEC	national electrical code	PBS	push button station
NEMA	National Electrical Manufacturer's Association	PC	piece
		PCC	precast concrete
NFPA	National Fire Protection Association	PCF	pounds per cubic foot
NI	nickel	PCPL	cement plaster (portland)
NIC	not in contract	PD	pavement drain
NL	nailable	PE	porcelain enamel
NMT	nonmetallic	PED	pedestal
NO.	number	PERF	perforate(d)
NOM	nominal	PERI	perimeter
NP	neuropsychiatric	PFL	pounds per lineal foot
NR	noise reduction	PG	plate glass
NRC	noise reduction coefficient	PH	phase
N.T.S.	not to scale	PHAR	pharmacy
O.D.	outside diameter	PI	point of intersection
OA	outside air	PIPU	prefab isolation power unit
OB WG	obscure wire glass	PIV	post indicating valve
OBGL	obscure glass	PK	parking
OBSC	obscure	PL	plate
OC	on center(s)	PLAS	plaster
OCEW	on center each way	PLAS LAM	plastic laminate
OFF	office	PLATF	platform
OH	overhead	PLBG	plumbing

Abbreviation	Definition
PLG	piling
PLYWD	plywood
PNL	panel
PNT	paint(ed)
POL	polish
PORC	porcelain
PORT	portable
PPG	polished plate glass
PPM	parts per million
PR	pair
PREFAB	prefabricate(d)
PREFIN	prefinished
PRF	preformed
PROJ	project
PRV	pressure-regulating valve
PS	pipe space
PSC	prestressed concrete
PSF	pounds per square foot
PSI	pounds per square inch
PT	pneumatic tube
PT.	point
PTC	post-tensioned concrete
PTD	paper towel dispenser
PTR	paper towel receptor
PV	pave(d)(ing)
PVC	polyvinylchloride
PVMT	pavement
PW	pass window
QT	quarry tile
QT.	quart
QTRS	quarters
QTY	quantity
R.D.	roof drain
R.H.	right hand(ed)
R&S	casework in clergy room and sacristy, chaplain service
RA	return air
RAD	radius
RAG	return air grille
RAR	return air register
RB	rubber base, resilient base
RBL	rubble stone
RBT	rabbet, rebate
RC	remote control
RCP	reinforced concrete pipe
RCVR	receiver
RDGE	ridge
RECEP	receptacle
RECR	recreation
RECT	rectifier
REF	reference
REFR	refrigerator
REG	reglet
REG.	register
REINF	reinforcing, reinforced, reinforcement
REM	remove(able)
REQ'D, REQD	required
RESIL	resilient
RET	return
REV	revision(s), revised
RFG	roofing
RFH	roof hatch
RFL	reflect(ed)(ive)(or)
RGE	range
RGH	rough
RH	relative humidity
RK	rack
RL	rail(ing)
RM	room
RND	round
RO	rough opening
ROW	right of way
RP	retractable partition
RPM	revolutions per minute
RPRT	raised pattern rubber tile
RSR	riser
RT	rubber tile
RUB	rubber
RVS	reverse (side)
RVT	rivet
RWC	rainwater conductor
S	south
S.B.	security bars
S.C.	special coating
S&R	shelf and rod
SA	supply air
SB	splash block

Abbreviation	Definition	Abbreviation	Definition
SC	solid core	STD	standard
SCHED	schedule	STG	seating
SCI	spinal cord injury	STGR	stringer
SCN	screen	STL	steel
SCR	screw	STN	stone
SCT	structural clay tile	STOR	storage
SCUT	scuttle	STRL	structural
SD	storm drain	STWY	stairway
SDI	Steel Door Institute	SUB FL	subfloor
SECT	section	SUSP	suspended
SECY	secretary	SVF	sheet vinyl flooring
SEQ	sequence	SW	switch
SFGL	safety glass	SWBD	switchboard
SFTU	structural facing tile unit	SYM	symmetrical
SFU	structural facing unit	SYN	synthetic
SG	sheet glass	SYS	system
SH	shelf, shelving	T	tread
SHLD	shoulder	T'STAT	thermostat
SHO	shore(d)(ing)	T&G	tongue and groove
SHT	sheet	TA	table
SHTG	sheathing	TAN	tangent
SIM	similar	TB	towel bar
SJI	Steel Joist Institute	TC	terra cotta
SKL	skylight	TEL	telephone
SL	sleeve	TEMP	temperature
SM	sheet metal	TEMP.	temporary
SMS	sheet metal screws	TERM	terminal
SNT	sealant	TERR	terrazzo
SOV	shut off valve	TGL	toggle
SP	static pressure	TH	truss head
SPC	spacer	THK	thick(ness)
SPD	soundproof door	THR	threshold
SPEC(S)	specification(s)	TKBD	tackboard
SPF	soundproof	TKS	tackstrip
SPH	space heater	TO	top of
SPKR	speaker	TOIL	toilet
SPL	special	TOL	tolerance
SQ	square	TOPO	topography
SQHD	square head	TPD	toilet paper dispenser
SQUAD	squadron	TPTN	toilet partition
SS, SST	stainless steel	TR	transom
SSK	service sink	TRANS	transverse
SSMR	standing seam metal roofing	TSL	top of slab
STA	station	TST	top of steel

Abbreviation	Definition
TT	terrazzo tile resinous matrix
TV	television
TW	top of wall
TYP	typical
UC	unit cooler
UG	underground
UH	unit heater
UL	Underwriters Laboratories
UNEX	unexcavated
UNFIN	unfinished
UPS	uninterruptable power system
UR	urinal
UT	utility
UV	unit ventilator
V	volt
V.T.	voltage transformer
VA	vinyl asbestos
VAB	vapor barrier
VAR	varnish
VAT	vinyl asbestos tile
VB	vinyl base
VCP	vitrified clay pipe
VCT	vinyl composition tile
VD	vault door
VENT	ventilator(tion)
VERT	vertical
VEST	vestibule
VF	vinyl fabric
VG	vertical grain
VH	vinyl homogeneous
VIN	vinyl
VJ	v-joint(ed)
VL	clinical laboratory equipment
VNR	veneer
VOL	volume
VR	radio isotope lab equipment
VRM	vermiculite
VS	vent stack
VT	vinyl tile
VTR	vent thru roof
VWC	vinyl wall covering
W	west
W/	with
W/O	without
W/C	wheelchair
W.D.	waste drain
W.S.	waste stack
WB	wet bulb
WC	water closet
WCO	wood-cased opening
WD BLK	wood blocking
WD	wood
WD DR	wood door
WF	wire flange
WG	wire glass
WH	wall hung
WHB	wheel bumper
WHM	watthour meter
WHT	white
WI	wrought iron
WIN	window
WKSH	work shop
WM	wire mesh
WP	weatherproof
WPF, WPFG	water proof(ing)
WPT	working point
WR	waste receptacle
WRB	wardrobe
WS	waterstop
WSCT	wainscot
WT	weight
WTH	width
WTW	wall to wall
WWF	welded wire fabric
WWM	woven wire mesh
X	X-ray equipment radiology
XFMR	transformer
Y.D.	yard drain
YD	yard

Appendix B
Metric Construction Information

The following information was originally published in the Construction Metrication Council's *Metric in Construction* newsletter, Volume 3, Issue 3, dated May-June 1994. *Metric in Construction* is a bimonthly newsletter designed to inform the building community about metrication in U.S. construction. The Construction Metrication Council was created by the National Institute of Building Sciences to provide industry-wide, public, and private sector support for the metrication of Federal construction and to promote the adoption and use of the metric system of measurement as a means of increasing the international competitiveness, productivity, and quality of the U.S. construction industry. The current Chairman of the Council is Mr. Thomas R. Rutherford, P.E., DoD, and the Executive Director is Mr. William A. Brenner, AIA. The Center would like to thank Mr. Brenner for allowing the reprint of the Council's newsletter information. For information on how to subscribe to *Metric in Construction*, please address all inquiries to the following:

Construction Metrication Council
National Institute of Building Sciences
1090 Vermont Avenue, N.W., Suite 700
Washington, D.C. 20005-4905
Telephone: (202) 289-7800
FAX: (202) 289-1092
Internet: *www.nibs.org*

ONE MORE TIME: WHAT WILL CHANGE AND WHAT WILL STAY THE SAME?

METRIC MODULE AND GRID

What will change

- The basic building module, from 4 inches to **100 mm**.
- The planning grid, from 2' x 2' to **600 x 600 mm**.

What will stay the same

- A module and grid based on rounded, easy-to-use dimensions.

DRAWINGS

What will change

- Units, from feet and inches to millimeters for all building dimensions and to meters for large site plans and civil engineering drawings. Unit notations are unnecessary: if there's no decimal point, it's millimeters; if there's a decimal point carried to one, two, or three places, it's meters. Centimeters are not used in construction.

- Drawing scales, from inch-fractions-to-feet to true ratios. Preferred metric scales are **1:1** (full size); **1:5** (close to 3" = 1'-0"); **1:10** (between 1" = 1'-0" and 1-1/2" = 1'-0"); **1:20** (between 1/2" = 1'-0" and 3/4" = 1'-0"); **1:50** (close to 1/4" = 1'-0"); **1:100** (close to 1/8" = 1'-0"); **1:200** (close to 1/16" = 1'-0"); **1:500** (close to 1" = 40'-0"); **1:1000** (close to 1" = 80'-0").

- Drawing sizes, to the ISO "A" series: **AO** (**1189 x 841 mm**, 46.8 x 33.1 inches); **A1** (**841 x 594 mm**, 33.1 x 23.4 inches); **A2** (**594 x 420 mm**, 23.4 x 16.5 inches); **A3** (**420 x 297 mm**, 16.5 x 11.7 inches); **A4** (**297 x 210 mm**, 11.7 x 8.3 inches). Of course, metric drawings can be made on any size paper.

What will stay the same

- Drawing contents.

Never use dual units (both inch-pound and metric) on drawings. It increases dimensioning time, doubles the chance for errors, makes drawings more confusing, and delays the learning process.

SPECIFICATIONS

What will change

- Units of measure, from feet and inches to **millimeters** for linear dimensions, from square feet to **square meters** for area, from cubic yards to **cubic meters** for volume (except use **liters** for fluid volumes), and from other inch-pound units to metric units as appropriate.

What will stay the same

- Everything else in the specification.

Do not use dual units in specifications except when the use of an inch-pound measure serves to clarify an otherwise unfamiliar metric measure; then place the inch-pound unit in parentheses after the metric. For example, "7460 W (10 horsepower)." All unit conversions should be **checked by a professional** to ensure that rounding does not exceed allowable tolerances.

FLOOR LOADS

What will change

- Floor load designations, from "psf" to kilograms per square meter (**kg/m^2**) for everyday use and kilonewtons per square meter (**kN/m^2**) for structural calculations.

What will stay the same

- Floor load requirements.

Kilograms per square meter often are used to designate floor loads because many live and dead loads (furniture, filing cabinets, construction materials, etc.) are measured in kilograms. However, kilonewtons per square meter or their equivalent, megapascals, are the proper measure and should be used in structural calculations.

CONSTRUCTION PRODUCTS

What will change

- Modular products: brick, block, drywall, plywood, suspended ceiling components, and raised floors. They will undergo "hard" conversion; that is, their dimensions will change to new rounded "hard" metric numbers to fit the universal **600 x 600 mm** metric planning grid.

- A number of other products, such as concrete reinforcing bars and various

kinds of fasteners. They are being converted to hard metric sizes as the result of industry initiatives.

- Products that are custom fabricated for each job (for example, cabinets, stairs, handrails, ductwork, commercial doors and windows, structural steel, and precast concrete) or poured-in-place (concrete). Such products usually can be made to any size, inch-pound or metric, with equal ease so for metric jobs they simply will be fabricated or formed in metric.

What will stay the same

- The balance of products, since they are cut-to-fit at the jobsite (for example, framing lumber, woodwork, wiring, piping, and roofing) or are not dimensionally sensitive (for example, fasteners, hardware, electrical components, plumbing fixtures, HVAC equip ment, and gravel). Such products will be just "soft" converted—that is, relabeled in metric. A 2-3/4" x 4-1/2" wall switch face plate will be relabeled 70 x 115 mm and a 30 gallon tank, 114 L. Eventually manufacturers may convert many of these products to new rounded "hard" metric sizes, but only when it becomes convenient to do so.

"2-BY-4" STUDS AND OTHER "2-BY" FRAMING (BOTH WOOD AND METAL)

What will change

- Spacing, from 16" to **400 mm**, and 24" to **600 mm**.

What will stay the same

- Cross sections.

"2-bys" are produced in fractional inch dimensions now so there is no need to convert them to new rounded "hard" metric dimensions. 2-by-4s may keep their traditional name or perhaps they'll be relabeled a nominal 50 x 100 mm or a more exact size, such as 38 x 89 mm.

DRYWALL, PLYWOOD, AND OTHER SHEET GOODS

What will change

- Widths, from 4'-0" to **1200 mm**.

- Heights, from 8'-0" to **2400 mm**, 10'-0" to **3000 mm**.

What will stay the same

- Thicknesses, so fire, acoustic, and thermal ratings won't have to be recalculated.

Metric drywall and plywood are readily available, but with a possible cost penalty for small orders. Metric rigid insulation may not be available at this time.

BATT INSULATION

What will change

- Nominal width labels, from 16" to **16"/400** mm and 25" to **24"/600 mm**.

What will stay the same

- Everything else.

Batts will not change in width; they'll just have a tighter "friction fit" when installed among metric-spaced framing members.

DOORS

What will change

- Height, from 6’-8" to **2050 mm** or **2100 mm** and from 7’-0" to **2100 mm**.
- Width, from 2’-6" to **750 mm**, from 2’-8" to **800 mm**, from 2’-10’ to **850 mm**, from 3’-0" to **900 mm** or **950 mm**, and from 3’-4" to **1000 mm**.

What will stay the same

- Door thicknesses.
- Door materials and hardware.

For commercial work, doors can be ordered in any size since they normally are custom-fabricated.

CEILING SYSTEMS

What will change

- Grids and lay-in ceiling tile, air diffusers, and lighting fixtures— from 2’ x 2’ to **600 x 600 mm** and from 2’ x 4’ to **600 x 1200 mm**.

What will stay the same

- Grid profiles, tile thicknesses, air diffuser capacities, florescent tubes, and means of suspension.

RAISED FLOOR SYSTEMS

What will change

- Grids and lay-in floor tile, from 2’ x 2’ to **600 x 600 mm**.

What will stay the same

- Grid profiles, tile thicknesses, and means of support.

HVAC CONTROLS

What will change

- Temperature units, from Fahrenheit to Celsius.

What will stay the same

- All other parts of the controls.

Controls are now digital so temperature conversions can be made with no difficulty.

BRICK

What will change

- Standard brick to **90 x 57 x 190 mm.**
- Mortar joints from 3/8" and 1/2" to **10 mm**.
- Brick module from 2’ x 2’ to **600 x 600 mm**.

What will stay the same

- Brick and mortar composition.

Of the 100 or so brick sizes currently made, 5 to 10 are within a millimeter of a metric brick so the brick industry will have no trouble supplying metric brick.

CONCRETE BLOCK

What will change

- Block sizes to **190 x 190 x 390 mm**.

- Mortar joints from 1/2" to **10 mm**.

- Block module from 2’ x 2’ to **600 x 600 mm**.

What will stay the same

- Block and mortar composition.

SHEET METAL

What will change

- Designation from “gage” to millimeters.

What will stay the same

- Thickness, which will be soft converted to hundredths of a millimeter.

In specifications, use millimeters only or millimeters with the gage in parentheses.

CONCRETE

What will change

- Strength designations from “psi” to megapascals, rounded to the nearest 5 megapascals per ACI 318M, such as: 2500 psi to **20 Mpa**; 3000 psi to **25 MPa**; 3500 psi to **25 Mpa**; 4000 psi to **30 Mpa**; 4500 psi to **35 Mpa**; 5000 psi to **35 Mpa**. The amount of rounding will depend upon the use of the concrete.

What will stay the same

- Everything else.

REBAR [revised 10/95]

What will change

- Rebars will probably remain the same size but be given new metric designations as follows: #3 to #10M, #4 to #13M, #5 to #16M, #6 to #19M, #7 to #22M, #8 to #25M, #9 to #29M, #10 to #32M, #11 to #36M, #14 to #45M, and #18 to #57M. Call the Concrete Reinforcing Steel Institute for details: 708-517-1200.

What will stay the same

- Concrete.

GLASS

What will change

- Cut sheet dimensions from feet and inches to millimeters.

What will stay the same

- Sheet thickness, which can be rolled to any dimension and is often rolled in millimeters now. See ASTM C1036.

PIPE

What will change

- Nominal pipe and tubing designations from inches to millimeters.

What will stay the same

- Pipe cross sections.

Pipes and fittings are produced in decimal inch dimensions but named in rounded inch dimensions as a matter of convenience. A 2-inch pipe has neither an inside nor an outside diameter of 2 inches, a 1-inch fitting has

no exact 1-inch dimension, and a 1/2-inch sprinkler head contains no 1/2-inch dimension anywhere, so there is no need to "hard" convert pipes and fittings to rounded metric dimensions. Instead, they will not change size but simply be renamed in metric as follows: 1/8" = **6 mm**; 3/16" = **7 mm**; 1/4" = **8 mm**; 3/8" = **10 mm**; 1/2" = **15 mm**; 5/8"= **18 mm**; 3/4" = **20 mm**; 1" = **25 mm**; 1-1/4" = **32 mm**; 1-1/2"`= **40 mm**; 2" = **50 mm**; 2-1/2" = 65 mm; 3" = 80 mm; 3-1/2" = **90 mm**; 4" = **100 mm**; 4-1/2" = **115 mm**; and 1" = 25 mm for all larger sizes. See the July-August 1993 *Metric in Construction* newsletter for more information.

ELECTRICAL CONDUIT

What will change

- Nominal conduit designations from inches to millimeters.

What will stay the same

- Conduit cross sections.

Electrical conduit is similar to piping: it is produced in "soft" decimal inch dimensions but identified in nominal inch sizes. Neither nonmetallic nor metallic conduit will change size; they be relabeled in metric as follows: 1/2" = **16** (mm), 3/4" = **21**; 1" = **27**; 1-1/4" = **35**; 1-1/2" = **41**; 2" = **53**; 2-1/2" = **63**; 3" = **78**; 3-1/2" = **91**; 4" = **103**; 5" = **129**; 6" = **155**. These new metric names have been assigned by the National Electrical Manufacturers Association.

ELECTRICAL WIRE

What will change

- Nothing at this time.

What will stay the same

- Existing American Wire Gage (AWG) sizes.

STRUCTURAL STEEL

What will change

- Section designations, from inches to millimeters and from pounds per foot to kilograms per meter, in accordance with ASTM A6M.

- Bolts, to metric diameters and threads per ASTM A325M and A490M.

What will stay the same

- Cross sections.

Like pipe and conduit, steel sections are produced in decimal inch dimensions (with depths varying by weight) but are named in rounded inch dimensions. Metric names for equivalent sections are converted and rounded to the nearest 10 mm. Thus, a 10-inch section is relabeled as a 250 mm section and a 24-inch section is relabeled as a 610 mm section.

Appendix C
Detail Revision/Deletion Recommendation Form

Name: _____

Code: _____

Address: _____

_____

_____

Phone: _____

e-mail: _____

Detail Name: _____

Recommendation (Check one): Revise _____ Delete _____

Reason: _____

_____

_____

_____

Please attach additional pages if more space is required.

Mail to: U.S. Army Engineer Research and Development Center
Waterways Experiment Station
Tri-Service CADD/GIS Technology Center
CEWES-ID-C/Spangler
3909 Halls Ferry Road
Vicksburg, MS 39180-6199

REPORT DOCUMENTATION PAGE

Form Approved
OMB No. 0704-0188

1. AGENCY USE ONLY *(Leave blank)*	2. REPORT DATE	3. REPORT TYPE AND DATES COVERED
	June 1999	Report 2 of a series

4. TITLE AND SUBTITLE
CADD Details Library; Report 2, Mechanical Details

5. FUNDING NUMBERS

6. AUTHOR(S)
Tri-Service CADD/GIS Technology Center

7. PERFORMING ORGANIZATION NAME(S) AND ADDRESS(ES)
U.S. Army Engineer Research and Development Center
Waterways Experiment Station
3909 Halls Ferry Road, Vicksburg, MS 39180-6199

8. PERFORMING ORGANIZATION REPORT NUMBER
Technical Report CADD-93-1

9. SPONSORING/MONITORING AGENCY NAME(S) AND ADDRESS(ES)

10. SPONSORING/MONITORING AGENCY REPORT NUMBER

11. SUPPLEMENTARY NOTES
Available from National Technical Information Service, 5285 Port Royal Road, Springfield, VA 22161.

12a. DISTRIBUTION/AVAILABILITY STATEMENT
Approved for public release; distribution is unlimited.

12b. DISTRIBUTION CODE

13. ABSTRACT ***(Maximum 200 words)***

Several years ago, before computer-aided design and drafting (CADD) became the standard drafting tool in design, a seasoned draftsman might require, on the average, 40 hr to develop a sheet of construction details. By using CADD, this effort has easily been reduced to less than 15 hr. By employing the proposed CADD Details Library, an entire sheet of 20 details can be constructed in less than 10 min and, in many cases, require only minor project-specific modifications. By any measure, the development and reuse of CADD details represent a considerable time-saving tool.

It is important to realize that the CADD Details Library was developed by collecting existing details within the Department of Defense (DoD). The former Architectural Automation Task Group (AATG), now renamed the Architectural Automation Field Working Group (AAFWG), did not expend design funds to hire an architect/engineer or use in-house resources to develop completely new details. The AATG membership simply organized existing details into a generic format and cataloged them by type.

(Continued)

14. SUBJECT TERMS
CADD
CADD Details
Construction Details
Details
Mechanical Details

15. NUMBER OF PAGES
353

16. PRICE CODE

17. SECURITY CLASSIFICATION OF REPORT	18. SECURITY CLASSIFICATION OF THIS PAGE	19. SECURITY CLASSIFICATION OF ABSTRACT	20. LIMITATION OF ABSTRACT
UNCLASSIFIED	UNCLASSIFIED		

13. (Concluded).

To further simplify the use of the details library, the AAFWG tasked the Tri-Service CADD/GIS Technology Center (the Center) to develop an icon-driven software retrieval system. Developed with MDL and AutoLISP programming, the retrieval software will work on UNIX and DOS Intergraph platforms and AutoCAD DOS systems.

Typically, detailing on a design project does not begin prior to the 35-percent design phase. At the 35-percent phase, the designer has defined the building's structure and envelope requirements and is ready to begin selecting typical project details.

After reviewing the generic details in hardcopy format and identifying usable details, the designer/draftsman initiates the CADD Detail Manager program. The designer scrolls through the details listing, identifies the desired detail, reviews it within the display icon, and then places it on the details sheet. The retrieval program provides a rectangular box (representing the detail's dimensions) that may be dragged within the drawing file and placed by snapping to any of the grid intersection points on the provided details sheet. The detail is automatically placed, and the process is repeated until the entire sheet is filled. Simple modifications to the details to meet specific job requirements complete the sheet. The designer may also call up the details routine while in any design file, thus enabling detail placement anywhere within a set of drawings.

The CADD Details Library should always be considered a "living" document. This means the library may change as often as twice a year. The Center will occasionally announce a *Call For Details*, giving agency designers an opportunity to implement the format in their everyday work habits. After the details are collected, each Center Field Working Group will meet to review and assemble a new generation of the CADD Details Library. The Center will continue to distribute the new libraries and retrieval software. Through evolution, the library will grow to include all the design disciplines with cost incurred only for technical review, reproduction, and distribution.